




Schofield Building on the Corner of E. 9th and Euclid

Cleveland's Schofield Building is a historic building with limited space. An HVAC system was needed that would be efficient and competitive given the space constraints.



Aaon's Boiler Plant
For more information, [click here](#).

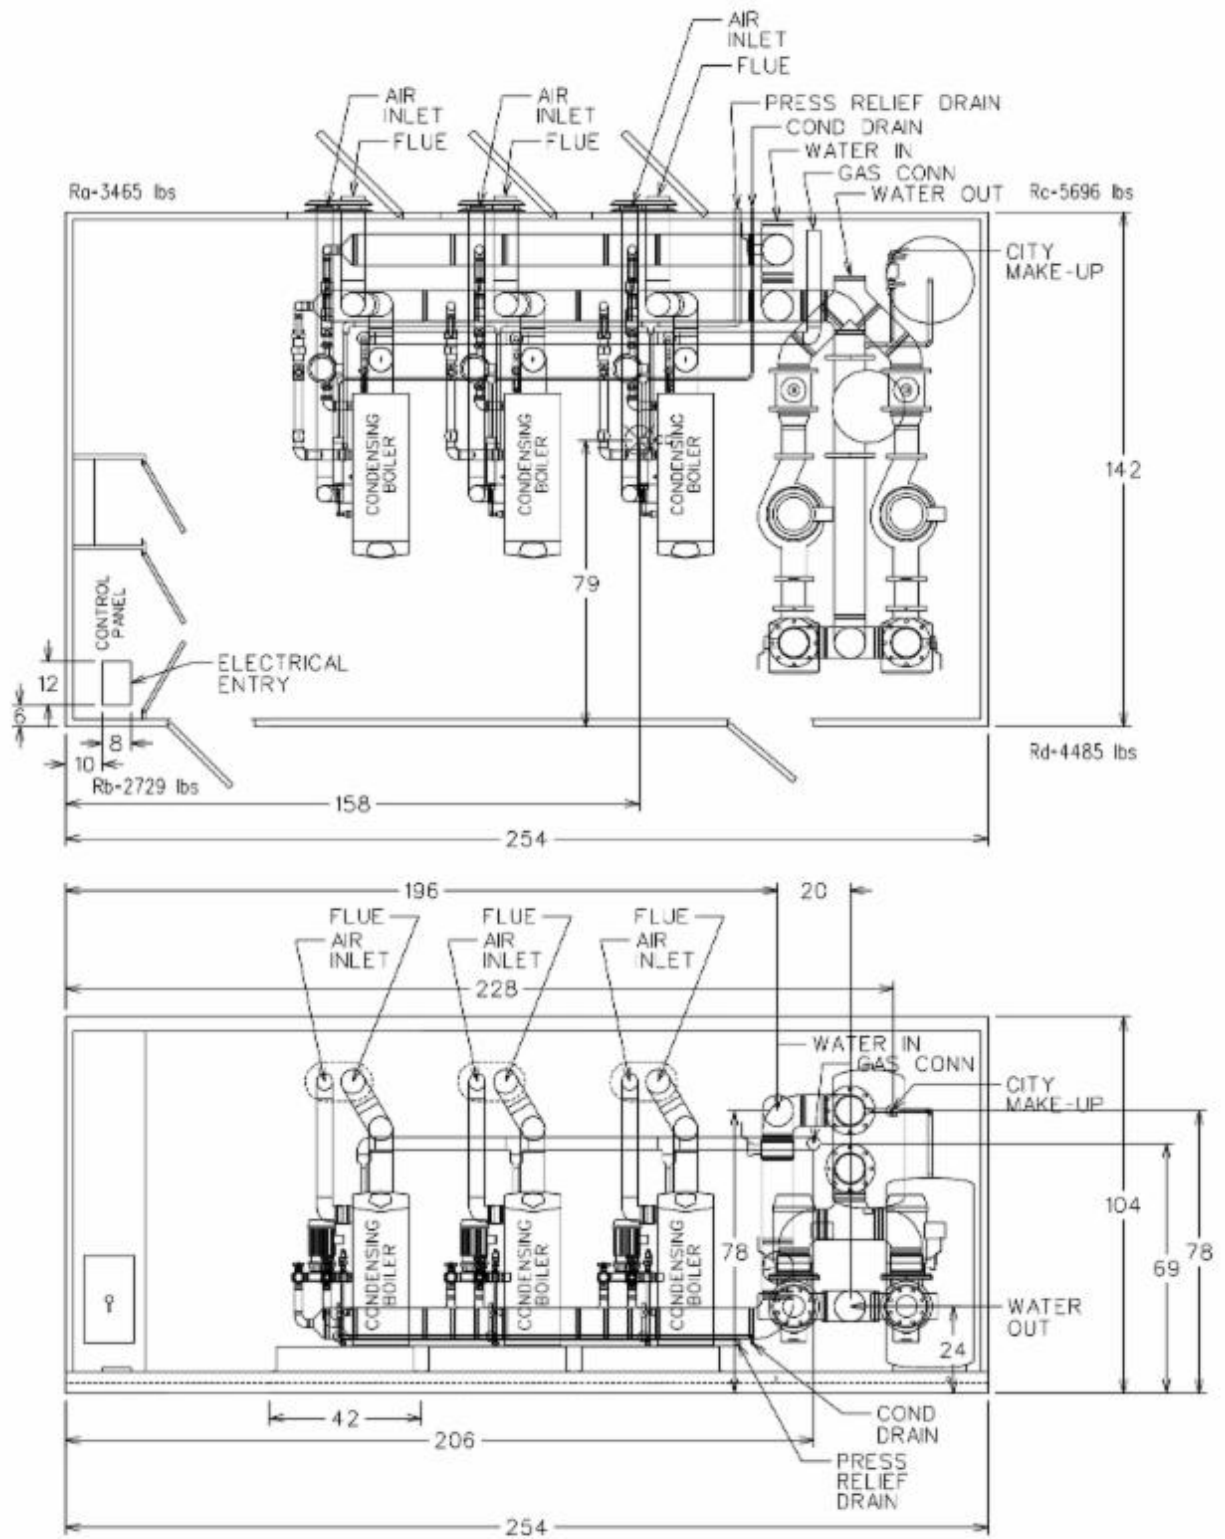




Aon's Rooftop WaterSource Heat Pump for the Buildings Corridor Make Up Air
 For more information, [click here](#).



WaterFurnace Water Source Heat Pump
 For more information, [click here](#).

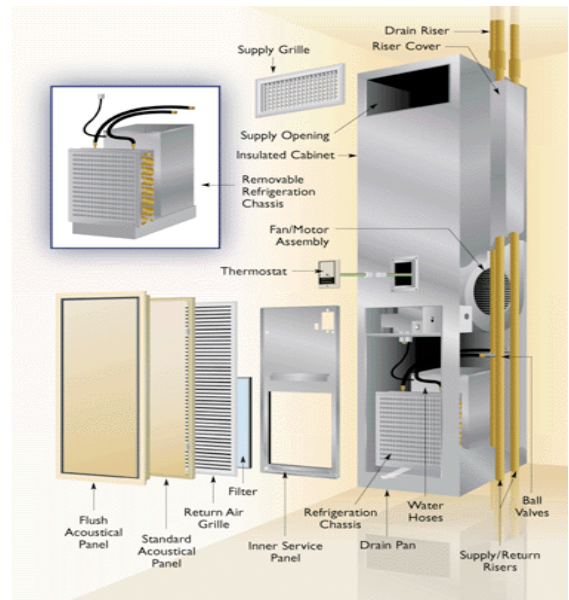

Whalen "Stacker" Water Source Heat Pump System
 For more information, [click here](#).

For a complete narrative on the Schofield Building HVAC System's, please [click here](#).

For more information on finding the right HVAC solution, please contact Jerry Cohen at jerryc@jacco.com, or visit our website at www.jacco.com.

What We're Saying

Aaon H3 & SB with Heat Recovery [Click Here](#)

Seminars

Jacco will be hosting a series of Seminars!

30min Design

Ebtron's Cost Saving Benefits [Click Here](#)

WaterFurnace Modular Chillers [Click Here](#)

Aaon Pool Units [Click Here](#)

March 11:
Applying Energy Recovery Systems

Cleveland: 7 a.m. - 9 a.m.
Akron: 11 a.m. - 1 p.m.
Youngstown: 4 p.m. - 6 p.m.

[Click Here For More Information](#)



Copyright © 2015 All Rights Reserved.

[Forward this email](#)



This email was sent to jerryc@jacco.com by jerryc@jacco.com | [Update Profile/Email Address](#) | Rapid removal with [SafeUnsubscribe™](#) | [About our service provider.](#)



Jacco & Associates | 61 Milford DR | Hudson | OH | 44236