



Energy Recovery Systems

Greg Drensky
Vice President
Jacco & Associates

Agenda:

- Who is Jacco?
- What is energy recovery?
- Why use energy recovery?
- What types of energy recovery are there?
- What applications do they fit?

Who is Jacco

- Established 1968
 - Hudson, Ohio
 - Columbus, Ohio
 - Toledo, Ohio
- Focused on the Engineered Environment
 - Systems Knowledgeable
 - HVAC Systems
 - Service & Maintenance
 - Parts
- Full Circle Support
- 30 Minute Design



Who is Jacco


•Operations Group

- Erik Clapp
- Brenda Homjak
- Mike Spangler
- Chad Russell



Purpose Statement

The purpose of our Company is to solve our customers problems, in the most economical way, at all times optimizing the owning experience.

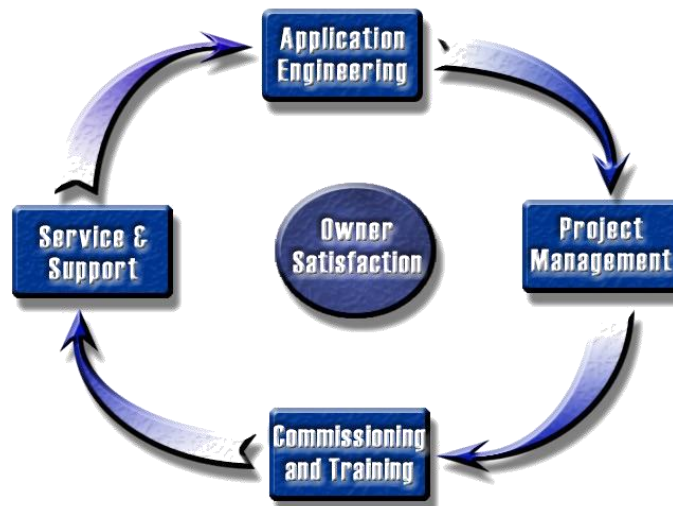

Who is Jacco

- 30 Minute Design

- Unit Performance
- Drawing
- Weights
- Electrical
- Specifications?
- Sequence of Operation?
- Cartoon?
- Narrative?



Who is Jacco

2015 Seminars

Seminars	Instructor	Date
Psychrometrics	JKC	14-Jan
The Refrigeration Cycle	JKC	11-Feb
Energy Recovery	GAD	11-Mar
Applied Rooftop Systems	JKC	8-Apr
VRF Design & Installation	GAD	13-May
Geothermal Systems	GAD	10-Jun
Chilled Beam, Radiant Cooling & DOAS	JKC	12-Aug
Vertical Market Systems	GAD	9-Sep
Building Pressure & Air Flow Measurement	GAD	14-Oct
Controlling HVAC Systems - Sequence of Operations	JKC	11-Nov

Web Site:

The screenshot shows a web browser window displaying the JACCO website. The browser's address bar shows the URL <http://www.jacco.com/>. The website features a dark blue header with the JACCO logo on the left, a 'SHOP NOW' button with a shopping cart icon on the right, and the contact information 'PARTS & SERVICES 330-463-0100'. Below the header is a search bar. The main content area is a large banner image of the MOCA Cleveland building, with a white text box on the right containing the following text:

Jacco & Associates
Proud To Provide
A system for the new Museum of Contemporary Art in Cleveland, Oh that utilizes geothermal to maintain tight temperatures that meet the challenge of a museum environment.

MOCA
MUSEUM OF CONTEMPORARY ART
CLEVELAND

At the bottom of the page is a navigation menu with the following links: ABOUT US, NEWS, HVAC SYSTEMS, SERVICE, PARTS, PORTFOLIO, NATIONAL ACCOUNTS, SEMINARS, 30 MIN DESIGN, CONTACT. The Windows taskbar at the bottom shows various application icons and the system clock indicating 9:30 PM on 3/9/2015.

Web Site:

Seminars

Jacco & Associates provides seminars for construction and engineering professionals throughout the year. For a list of upcoming seminars please contact **Brenda Homjak** at brendah@jacco.com.

Month	Description	Cleveland	Akron	Youngstown	Link
January 2015	Jacco's January Seminar we will be focusing on Practical Psychrometrics.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	Download Presentation
February 2015	Jacco's February Seminar we will be focusing on The Refrigerant Cycle.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	Download Presentation
March 2015	Jacco's March Seminar we will be focusing on Energy Recovery Systems.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
April 2015	Jacco's April Seminar we will be focusing on Applied Rooftop Systems.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
May 2015	Jacco's May Seminar we will be focusing on VRF Design & Installation.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
June 2015	Jacco's June Seminar we will be focusing on Best Practices for Geothermal Systems, Applications and Installation.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
August 2015	Jacco's August Seminar we will be focusing on Chilled Beams & DOAS.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
September 2015	Jacco's September Seminar we will be focusing on Vertical Market Systems.	7a.m. - 9a.m.	11a.m. - 1p.m.	4p.m. - 6p.m.	More Information
October 2015	Jacco's October Seminar we will be focusing on Building Pressure & Air Flow Measurement.	7a.m. - 9a.m.			

Web Site:

http://www.jacco.com/shop.html

File Edit View Favorites Tools Help




ABOUT US NEWS HVAC SYSTEMS SERVICE PARTS PORTFOLIO SEMINARS NATIONAL ACCOUNTS 30 MIN DESIGN CONTACT

Shop

By Brand

- AAON
- Alerton
- Panasonic
- Samsung
- Sanuvox
- Sanyo
- Seasons4
- ToxAlert
- Vapac
- WaterFurnace
- Wattmaster

Featured Parts

<p>R42350 One Stage Gas Valve</p>  <p>Price: \$142.00 In stock: 7</p> <p>Qty: 1 <input type="text"/> Add to Cart</p>	<p>P79910 Combustion Blower Wheel</p>  <p>Price: \$133.00 In stock: 1</p> <p>Qty: 1 <input type="text"/> Add to Cart</p>	<p>P4848B Combustion Blower Motor</p>  <p>Price: \$294.00 In stock: 0</p> <p>Qty: 1 <input type="text"/> Add to Cart</p>
---	--	---

11:29 PM 3/9/2015

What Is Energy Recovery?

- Ability to transfer energy from one air stream to another
- Proven technology over past decades and thousands of installations
- Reduction of required mechanical heating & cooling
- Temper OA conditions to simplify controlling to a point

Why Use Energy Recovery?

- Building codes require higher OA ventilation rates
- Controls indoor air pollution in crowded commercial building environments to assure proper occupant health and comfort.
- Outside air dilutes indoor pollutants including:
 - Human Generated 'Bioeffluents' (CO₂)
 - VOC's
 - Airborne Virus
 - Odor
- Mitigates the 'Sick Building Syndrome'

Why Use Energy Recovery?

- Reduced first time & installation costs
 - Smaller footprint
 - Lower gauge wiring
 - Less structural
- Reduced operational costs
- Reduce the load on the system by taking advantage of the work that has already been done to:
 - Heat
 - Cool
 - Humidify
 - Dehumidify

Why Use Energy Recovery?

STANDARD

ANSI/ASHRAE/IES Standard 90.1-2013
 (Supersedes ANSI/ASHRAE/IES Standard 90.1-2010)
 Includes ANSI/ASHRAE/IES Addenda listed in Appendix F

**Energy Standard
 for Buildings
 Except Low-Rise
 Residential Buildings**
 (I-P Edition)

See Appendix F for approval dates by the ASHRAE Standards Committee, the ASHRAE Board of Directors, the IES Board of Directors, and the American National Standards Institute.

This standard is under continuous maintenance by a Standing Standard Project Committee (SSPC) for which the Standards Committee has established a documented program for regular publication of addenda or revisions, including procedures for timely documented consensus action on requests for change to any part of the standard. The change submittal form, instructions, and deadlines may be obtained in electronic form from the ASHRAE Web site (www.ashrae.org) or in paper form from the Manager of Standards. The latest edition of an ASHRAE Standard may be purchased from the ASHRAE Web site (www.ashrae.org) or from ASHRAE Customer Service, 1791 Tullie Circle, NE, Atlanta, GA 30329-2305. E-mail: orders@ashrae.org. Fax: 404-521-5478. Telephone: 404-636-8400 (worldwide), or toll free 1-800-527-4773 (for orders in US and Canada). For reprint permission, go to www.ashrae.org/permissions.

© 2013 ASHRAE ISSN 1041-2336



ANSI/ASHRAE/USGBC/IES Standard 189.1-2014
 (Supersedes ANSI/ASHRAE/USGBC/IES Standard 189.1-2011)

**Standard for
 the Design of
 High-Performance
 Green Buildings**
 Except Low-Rise
 Residential Buildings

IGCC
 A Compliance Option of the International Green Construction Code™

See Appendix H for approval dates by the ASHRAE Standards Committee, the ASHRAE Board of Directors, the U.S. Green Building Council, the Illuminating Engineering Society of North America, and the American National Standards Institute.


This standard is under continuous maintenance by a Standing Standard Project Committee (SSPC) for which the Standards Committee has established a documented program for regular publication of addenda or revisions, including procedures for timely documented consensus action on requests for change to any part of the standard. The change submittal form, instructions, and deadlines may be obtained in electronic form from the ASHRAE website (www.ashrae.org) or in paper form from the ASHRAE Manager of Standards.

The latest edition of an ASHRAE Standard may be purchased on the ASHRAE website (www.ashrae.org) or from ASHRAE Customer Service, 1791 Tullie Circle, NE, Atlanta, GA 30329-2305, telephone: 404-636-8400 (worldwide), or toll free 1-800-527-4773 (for orders in the United States and Canada), or e-mail: orders@ashrae.org. For reprint permission, go to www.ashrae.org/permissions.

© 2014 ASHRAE and U.S. Green Building Council ISSN 1041-2336



Why Use Energy Recovery?

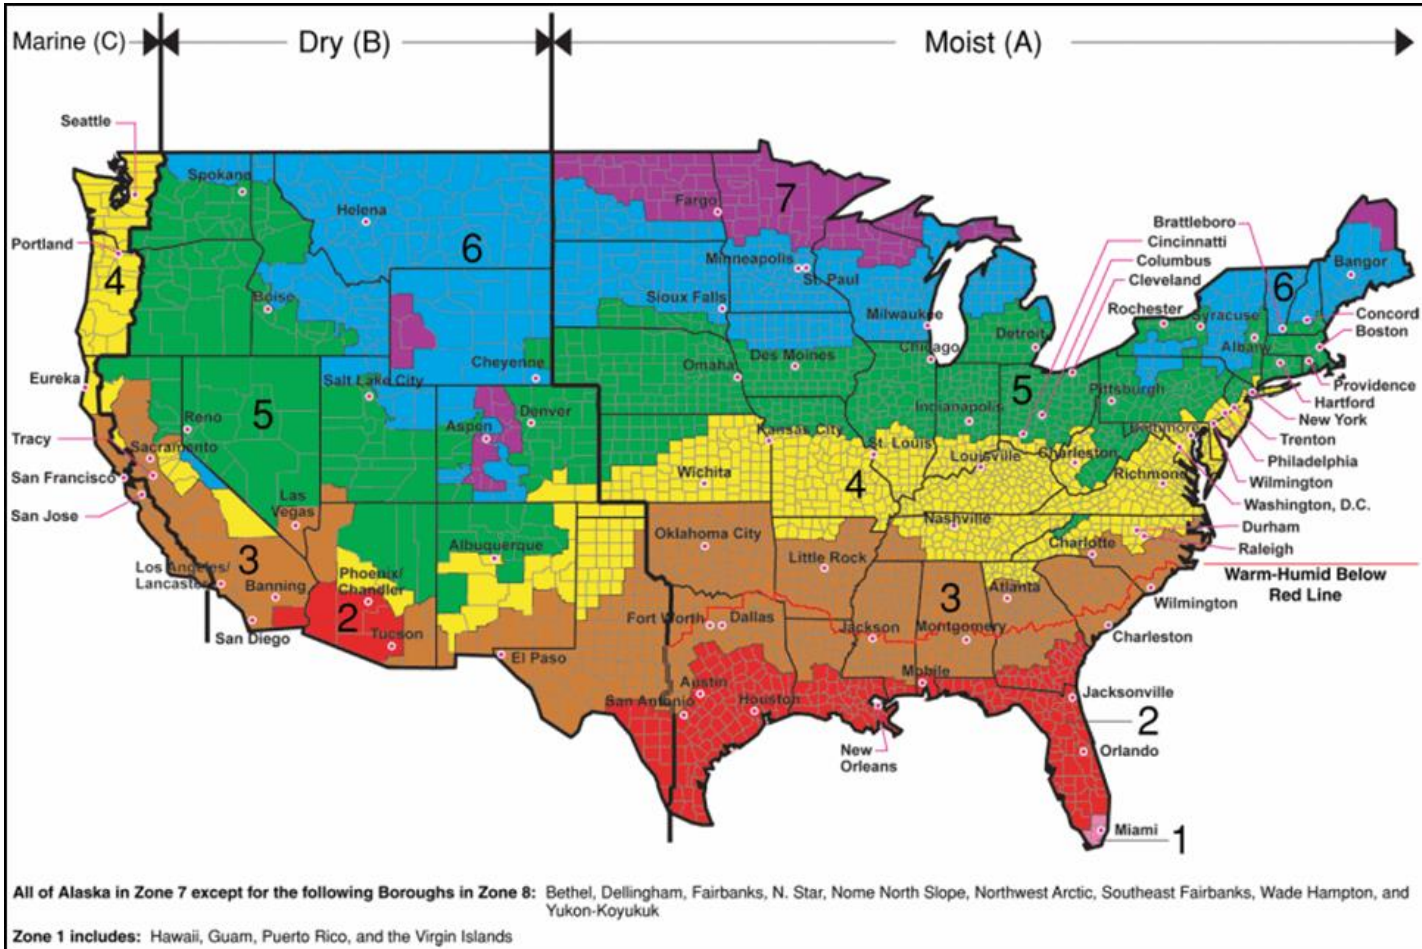

Why Use Energy Recovery?

TABLE 6.5.6.1 Exhaust Air Energy Recovery Requirements

Zone	% Outdoor Air at Full Design Airflow Rate					
	≥30% and < 40%	≥40% and < 50%	≥50% and < 60%	≥60% and < 70%	≥70% and < 80%	≥80%
	Design Supply Fan Airflow Rate (cfm)					
3B, 3C, 4B, 4C, 5B	NR	NR	NR	NR	≥5000	≥5000
1B, 2B, 5C	NR	NR	≥26000	≥12000	≥5000	≥4000
6B	≥11000	≥5500	≥4500	≥3500	≥2500	≥1500
1A, 2A, 3A, 4A, 5A, 6A	≥5500	≥4500	≥3500	≥2000	≥1000	>0
7,8	≥2500	≥1000	>0	>0	>0	>0

NR—Not required

Why Use Energy Recovery?

- 90.1-2010
 - Effectiveness Minimum of 50%
- 189.1-2014
 - Effectiveness Minimum of 60%

ARI Certification:

AHRI Standard 1060 (I-P)

2013 Standard for
**Performance Rating of Air-
to-Air Exchangers for
Energy Recovery
Ventilation Equipment**

AHRI
AIR-CONDITIONING, HEATING
& REFRIGERATION INSTITUTE

2111 Wilson Boulevard, Suite 500
Arlington, VA 22201, USA
www.ahrinet.org
PH 703.524.8800
FX 703.562.1942

we make life better™



ARI Certification:



Representing Manufacturers
of Heating, Ventilating,
Air-Conditioning and
Refrigeration Products

ARI 1060 Certification – Look for the Seal No Seal, No Certification!



The ARI 1060 Certification Program for air-to-air heat exchangers for energy recovery ventilation equipment was released on 19 January 2001. It is the culmination of several years work by the ARI Air-to-Air Energy Recovery Ventilation Equipment Product Section.

The ARI 1060 Certification Program is, to date, the **only** independent certification program for commercial energy recovery ventilation equipment in North America*. It certifies thermal and leakage performance of heat pipe, plate, and rotary wheel heat exchanger components rated at or above 50 scfm used in energy recovery ventilation equipment. A certified piece of equipment can be identified by the distinctive ARI Certification Seal affixed to the equipment, or affixed to the packaged equipment containing a certified heat exchanger and by its listing in the Certified Directory on the ARI website. The Seal can also be seen on the literature of certified manufacturers where certified ratings are shown.

ARI 1060 Rating:

1. Airflow, scfm
2. Pressure Drop, in H₂O
3. Sensible Effectiveness (at 100% and 75% rated airflow for heating and cooling conditions)
4. Latent Effectiveness (at 100% and 75% rated airflow for heating and cooling conditions)
5. Total Effectiveness (at 100% and 75% rated airflow for heating and cooling conditions)
6. Exhaust Air Transfer Ratio, Outdoor Air Correction Factor, and Purge Angle or Setting (if applicable) at 0.00 in H₂O and two or more pressure differentials
7. Tilt Angle, °, (at heating and cooling conditions, if applicable)

Heat Wheel:

ARI STANDARD 1060-2005

- The purpose of this standard is to establish for Air-to-Air Heat Exchangers intended for use in Air-to-Air Energy Recovery Ventilation Equipment: definitions; test requirements; rating requirements; minimum data requirements for Published Ratings; marking and nameplate data; and conformance conditions.

Why Use Energy Recovery?

3.5 **Effectiveness.** A ratio of the actual energy transfer (sensible, latent, or total) to the product of the minimum energy capacity rate and the maximum difference in temperature, humidity ratio, or enthalpy. The equation for determining Effectiveness is Equation C1 in Appendix C.

Effectiveness is not adjusted to account for that portion of the psychrometric change in the Leaving Supply Airflow that is the result of leakage of Entering Exhaust Airflow rather than exchange of heat or moisture between the airstreams.

3.5.1 *Sensible Effectiveness.* The Effectiveness determined in Section 3.5 using only measured dry bulb temperature differences, specific heat capacities and mass airflow rates.

3.5.2 *Latent Effectiveness.* The Effectiveness determined in Section 3.5 using only measured humidity ratios, heat of vaporization values, and mass airflow rates.

3.5.3 *Total Effectiveness.* The Effectiveness determined in Section 3.5 using only measured enthalpies and mass airflow rates.

3.5.4 *Net Effectiveness.* The Effectiveness adjusted to account for that portion of the psychrometric change in the Leaving Supply Airflow that is the result of leakage of Entering Exhaust Airflow rather than exchange of heat or moisture between the airstreams. The derivation of Net Effectiveness is given in Appendix C.

Why Use Energy Recovery?

APPENDIX C. CALCULATION OF EFFECTIVENESS – NORMATIVE

C1 *Effectiveness.* The sensible, latent or total Effectiveness of an Exchanger for use in Air-to-Air Energy Recovery Ventilation Equipment is described by Equation C1.

$$\varepsilon = \frac{C_2(X_1 - X_2)}{C_{\min}(X_1 - X_3)} \quad \text{C1}$$

Where:

ε = Sensible, latent, or total effectiveness

X = Dry-bulb temperature, T, humidity ratio, W, or total enthalpy, h, respectively, at the station locations indicated in Figure 1

C = Capacity Rate for each airstream

= $\dot{m}c_p$ for sensible effectiveness

= $\dot{m}h_{fg}$ for latent effectiveness

= \dot{m} for total effectiveness

C_{\min} = Minimum (C_2 or C_3)

\dot{m} = Mass flow rate of dry air, lb/min

c_p = Specific heat of dry air, Btu/lb°F


h_{fg} = Heat of vaporization of water, Btu/lb

X1 = Entering Air Supply

X2 = Leaving Air Supply

X3 = Entering Air Return

Why Use Energy Recovery?

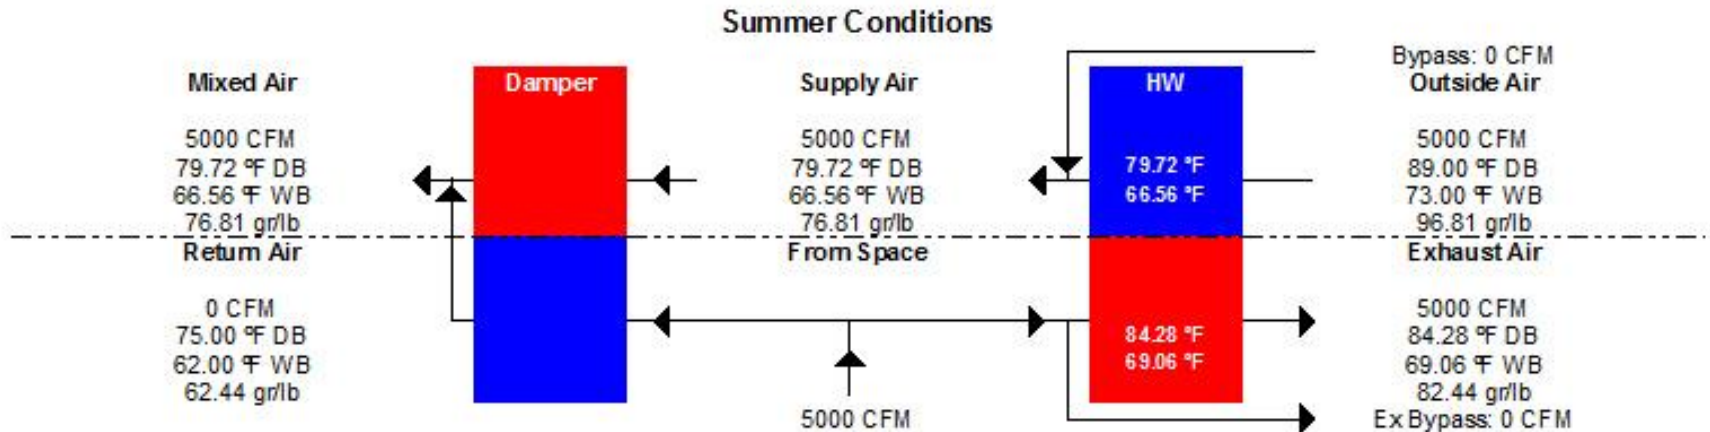

Cooling/Dehumidification

Total Capacity:	122.56 MBH
Sensible Capacity:	51.16 MBH
Latent Capacity:	71.40 MBH

Heating/Humidification

0.00 MBH
0.00 MBH
0.00 MBH

$$\text{Effectiveness} = 5000 * (89 - 79.72) / 5000 * (89 - 75)$$

$$\text{Effectiveness} = 66\%$$

ASHRAE OA Classification

- Class 1 Air:
 - Air with low contaminant intensity
 - Re-circulation is ok to any space
 - Examples: Offices, classrooms, churches, corridors
- Class 2 Air:
 - Moderate contaminant concentration & odors
 - Can be recirculated to any similar purpose & use spaces with Class 2 or Class 3 air similar in pollutant sources
 - Examples: Rest rooms, swimming pools, dining rooms, locker rooms, warehouses

ASHRAE OA Classification


- Class 3 Air:
 - Significant contaminant concentration or odors
 - Not suitable for recirculation
 - Examples: Kitchens, dry cleaners, beauty salons, labs, pet shops
- Class 4 Air:
 - Highly objectionable fumes or gases with potentially dangerous particles
 - Not suitable for recirculation
 - Examples: Paint spray booth, lab fume exhaust, kitchen grease exhaust

ASHRAE OA Classification

- Energy Recovery Re-Designation:
 - Class 2 air may be re-designated as Class 1 air in the process of recovering energy when it is diluted with outdoor air such that no more than 10% of the resulting airstream is Class 2 air. Class 3 air may be re-designated as Class 1 air in the process of recovering energy when it is diluted with outdoor air such that no more than 5% of the resulting airstream is Class 3 air.”

Types of Energy Recovery:

- Rotary Wheel
- Fixed Plate
- Heat Pipe
- Runaround Coil

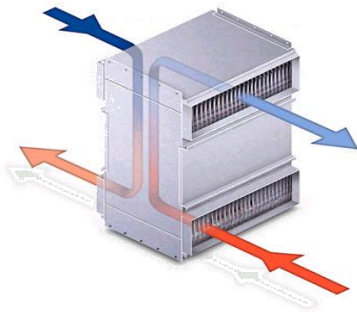

Heat Wheels:

- Total or sensible energy recovery
- Compact design
- Low frost threshold
- Moving parts involved
- Some maintenance required
- Potential cross-contamination
- 75-80% effectiveness
- 15 year lifetime

Heat Wheels:

- Spiral wound polymer film (sometimes AL)
- Wheel thickness between 1" to 3", some can go 12"
- Single piece or pie-shaped segments
 - Segments are sized for ease of handling during installation, removal and cleaning.
- Silica gel desiccant is used for moisture handling scenarios
- ARI Certification

Heat Wheels:

- Total Or Enthalpy Wheel
 - Includes Silica Gel
 - Transfers Latent Energy/Enthalpy Between Airstreams
- Sensible Wheel
 - Transfers Only Sensible Heat
 - Obviously Use Where You Don't Want Moisture Transfer

Heat Wheels:

- Polymer Wheel
 - Lightweight
 - Can Handle Corrosive Environments (salt)
 - Desiccant Permanently Imbedded
 - Lower Cost
- Aluminum Wheel
 - Higher Cost
 - Desiccant Degrades Over Time / Maintenance

Heat Wheels:

- Type A Silica Gel
 - Used In Enthalpy Wheels
 - Extremely Porous
 - Can Adsorb More Than 40% Of Own Weight In Water
 - 22 Angstroms In Diameter
 - 1 Gram = 800m² Surface Area
 - 1 Teaspoonful = Entire Football Field

Heat Wheels:

- Type A Silica Gel
 - Vapor Pressure
 - Silica Gel Adsorption Has Greater Capacity At Higher Relative Pressures
 - Water Is One Of The Highest Pressure Components
 - Competition With Other Components
 - Based On Vapor Pressure
 - Molecule's Polarity
 - Water Has High Polarity Creating Greater Attraction

Heat Wheels:


Table 1: Calculation of Relative Vapor Pressures for Various Components

Component	Concentration ¹ (ppm)	Relative Vapor Pressure (P/Ps)	Multiple of Water Pressure Versus Component ²
Water	14,900	0.5	1
Isopropyl Alcohol	400	0.0069	72
Ammonia	50	0.000006	87,639
Carbon Dioxide	5,000	0.00009	5,646
Formaldehyde	.75	0.0000001	3,406,109


¹ Concentrations are OSHA limits for 8 hour exposure. Typical buildings should be well below these levels. Water concentration is 75°F, 50% rh

² Ratio of water to component relative vapor pressure

Heat Wheel:

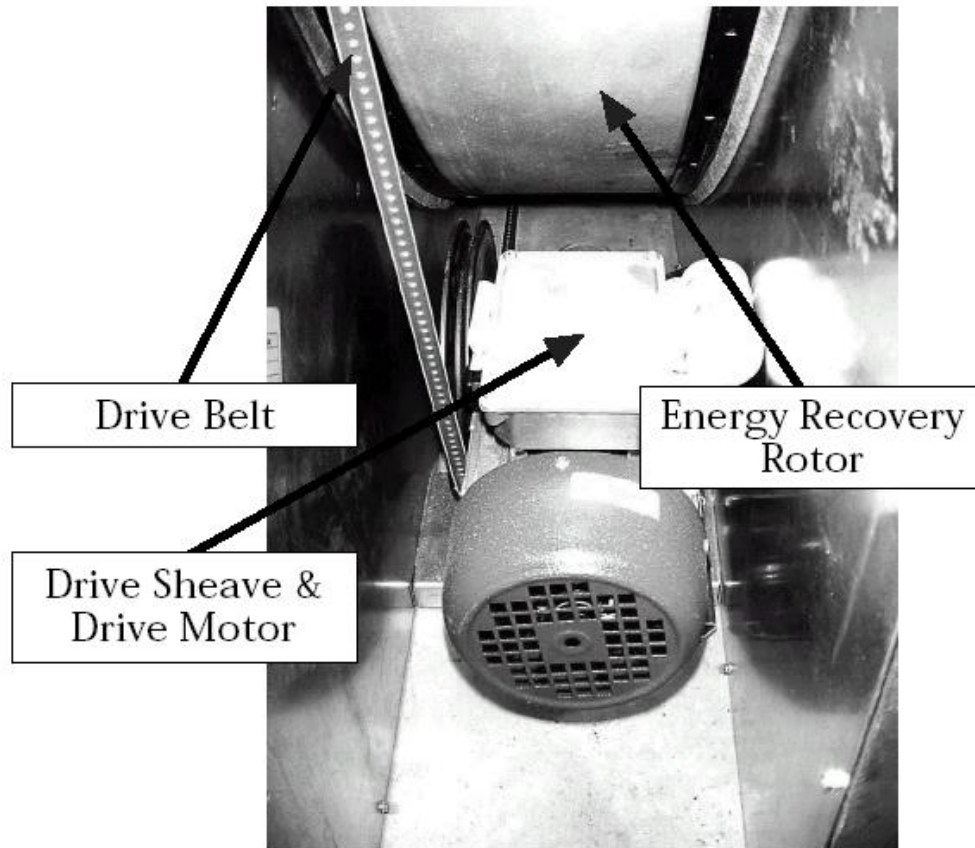


Heat Wheel:

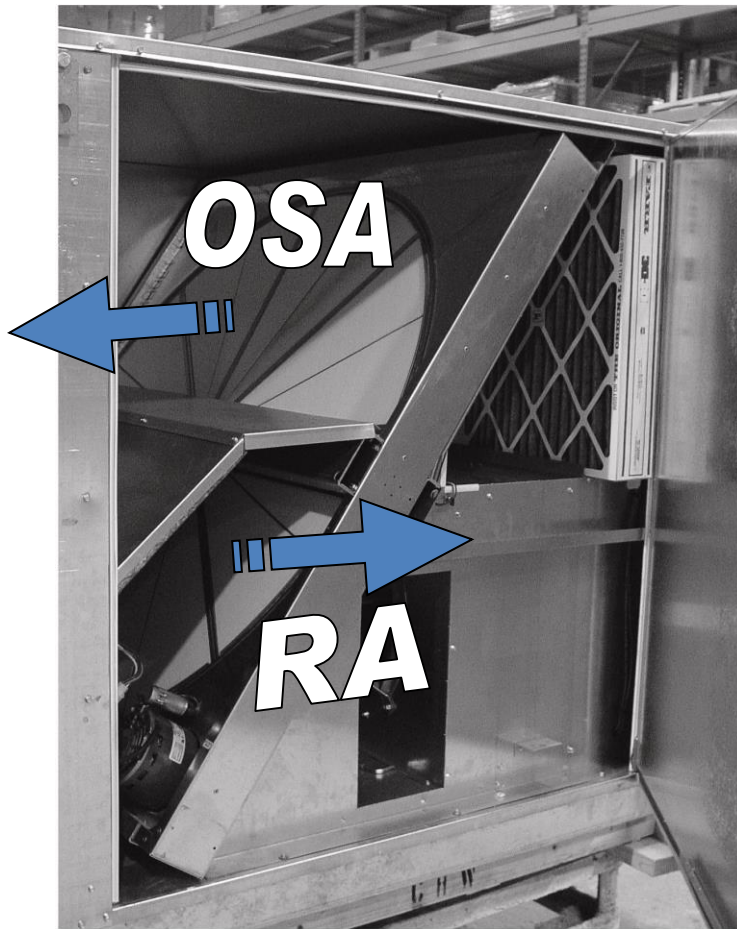

Heat Wheel:



Heat Wheel:

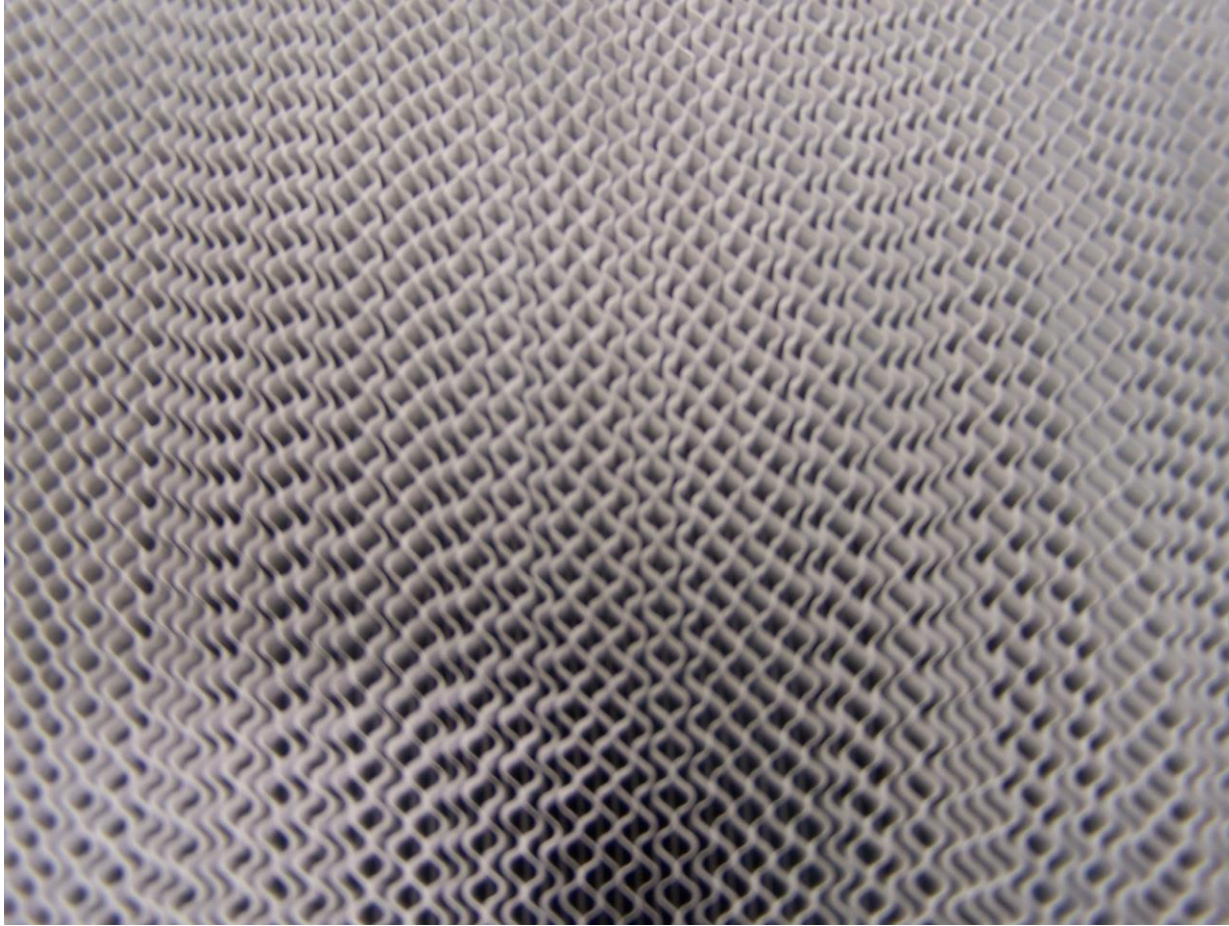

Heat Wheel:


Bypass Dampers

- Excess Air
- Economizer Operation




Heat Wheel Theory:

Rotary Air-to-Air Heat Exchange: 80%

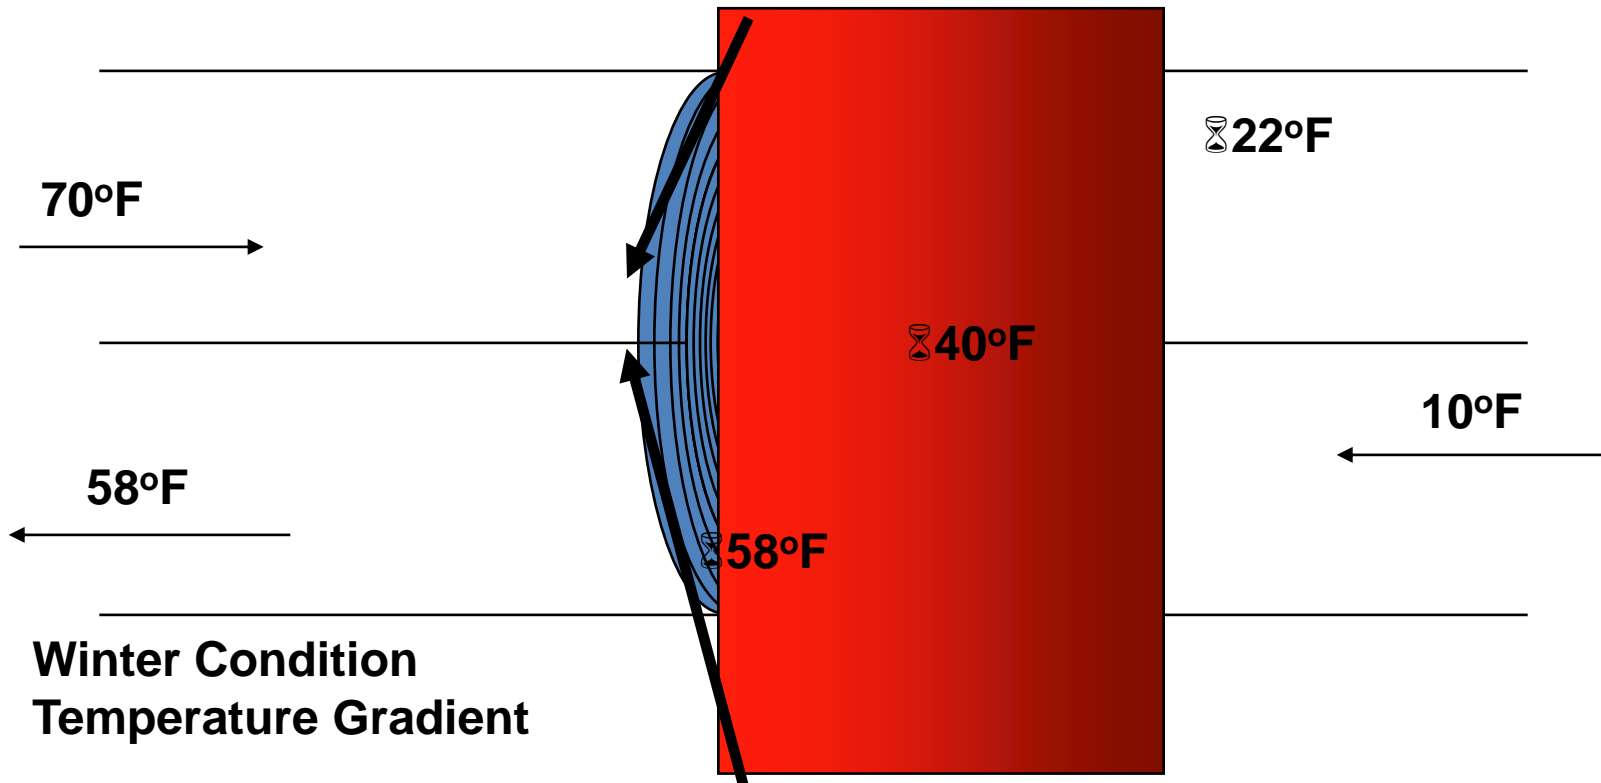

Heat Wheel Performances:

Summer Conditions

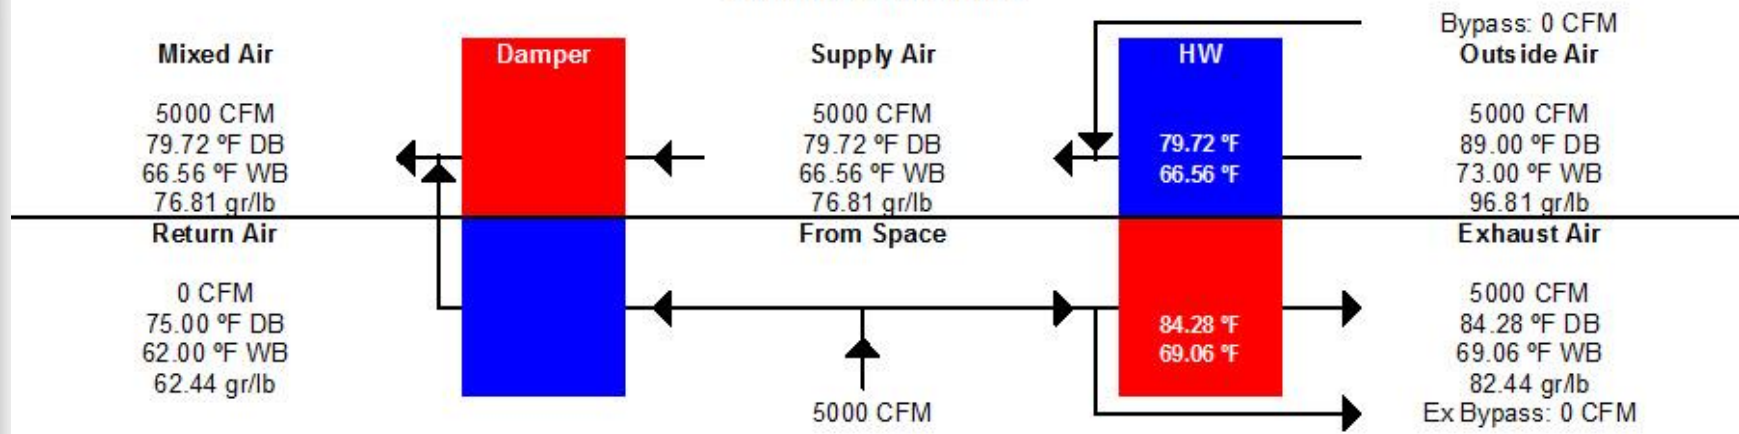

Cooling/Dehumidification


Total Capacity: **122.56 MBH**
 Sensible Capacity: **51.16 MBH**
 Latent Capacity: **71.40 MBH**

Heating/Humidification

0.00 MBH
0.00 MBH
0.00 MBH

Heat Wheel Performances:

Winter Conditions

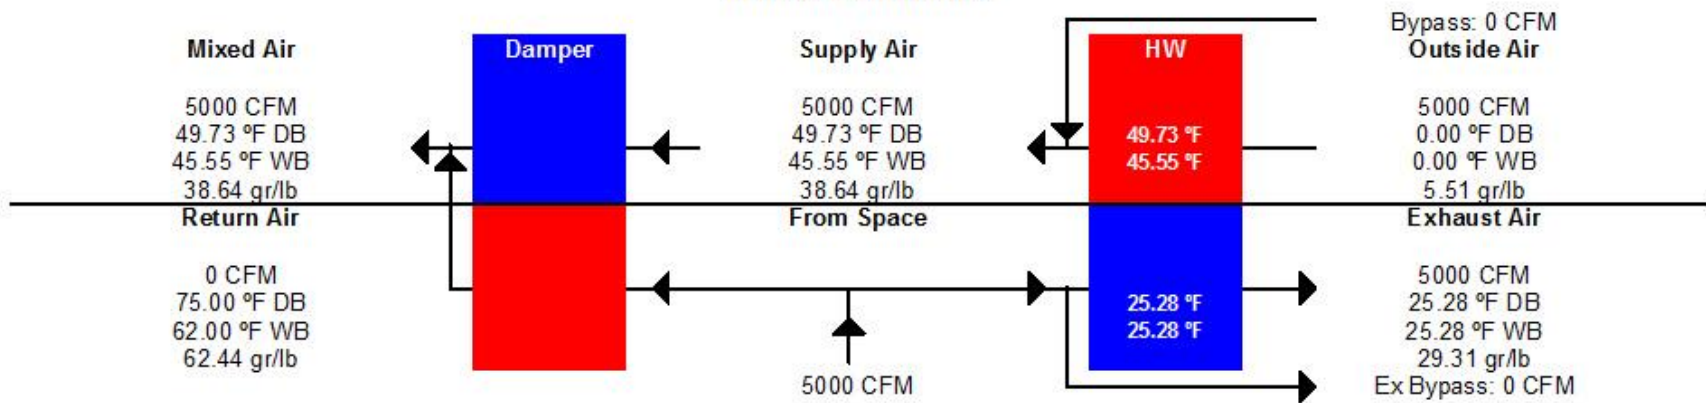

Cooling/Dehumidification

Total Capacity: 0.00 MBH
 Sensible Capacity: 0.00 MBH
 Latent Capacity: 0.00 MBH


Heating/Humidification

383.28 MBH
 269.51 MBH
 113.77 MBH

Heat Wheel Benefit:

The Total Energy Recovery Wheel Benefit


Total energy recovery significantly reduces the variations in operating conditions.

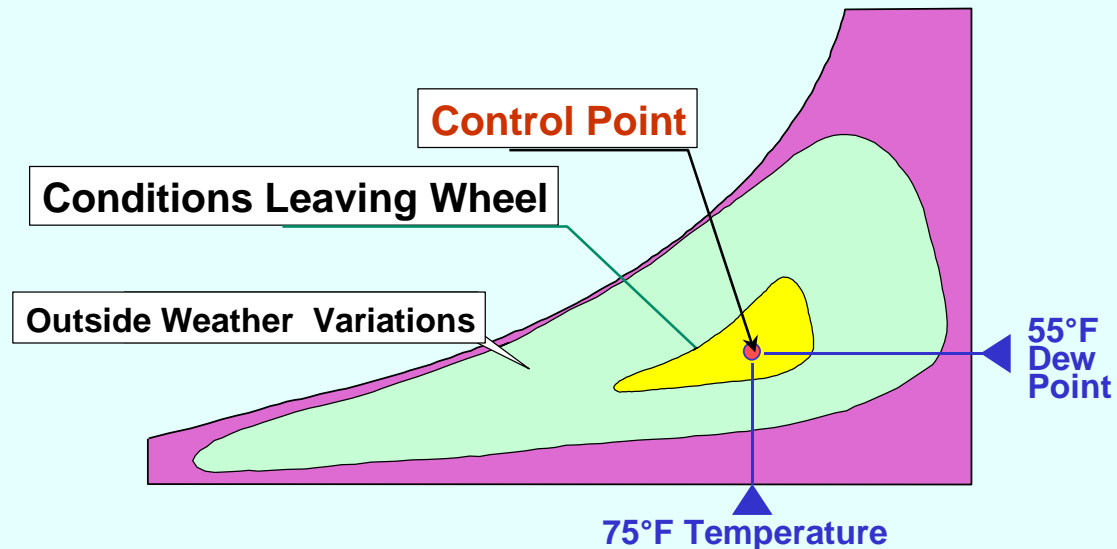


Purge System:

Purge Removes air internal to rotor during rotation


Field adjustable
purge angle
is dependent on
face velocity

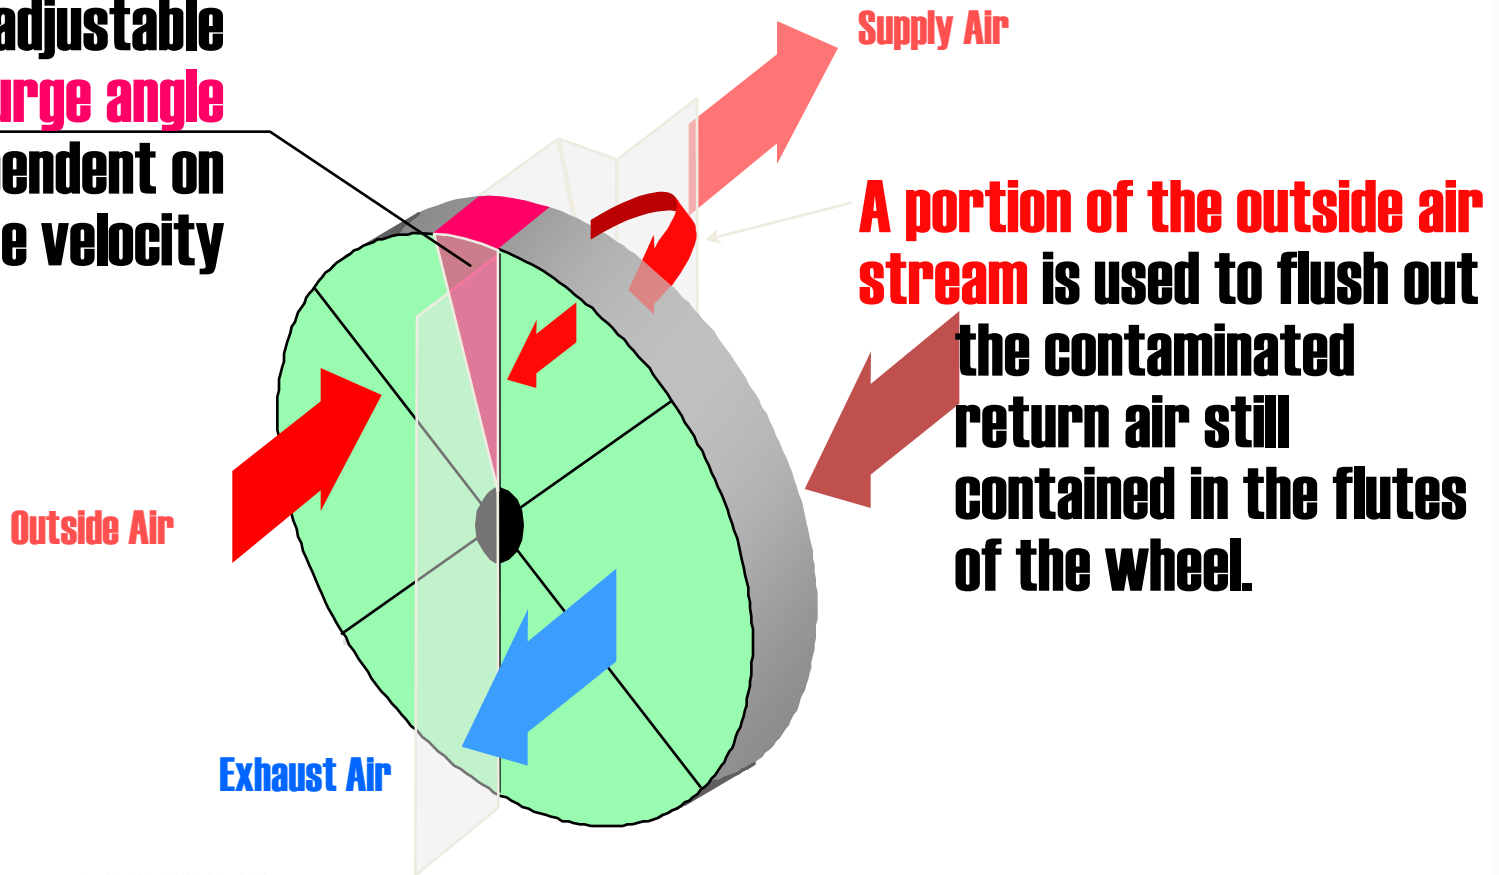

Purge System:


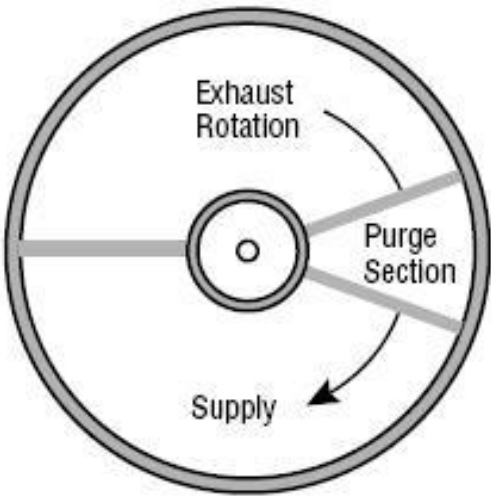


Front Cross Section with Upstream Exhaust

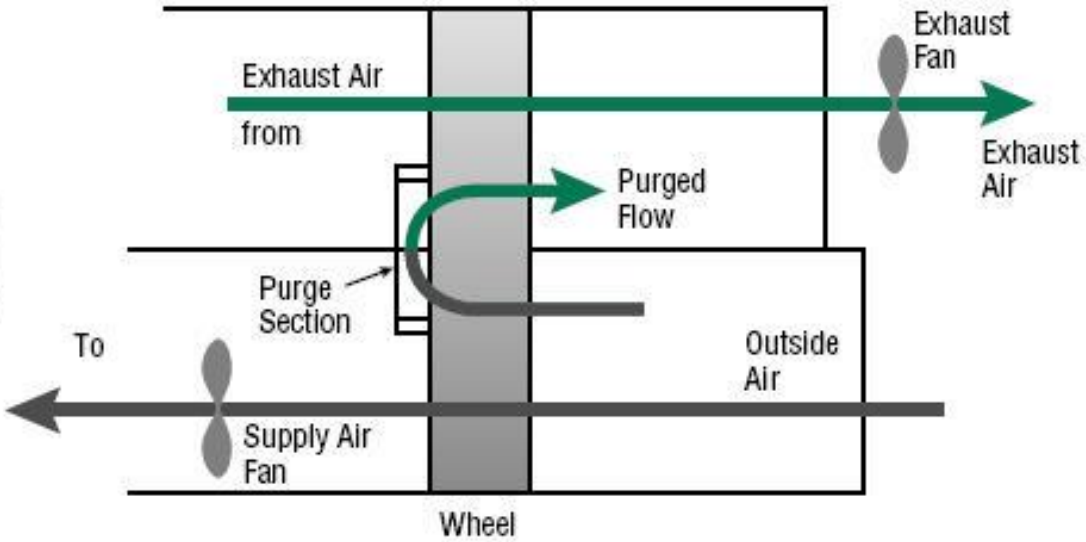


Side Cross Section with Purge Section

Heat Wheel With Purge:

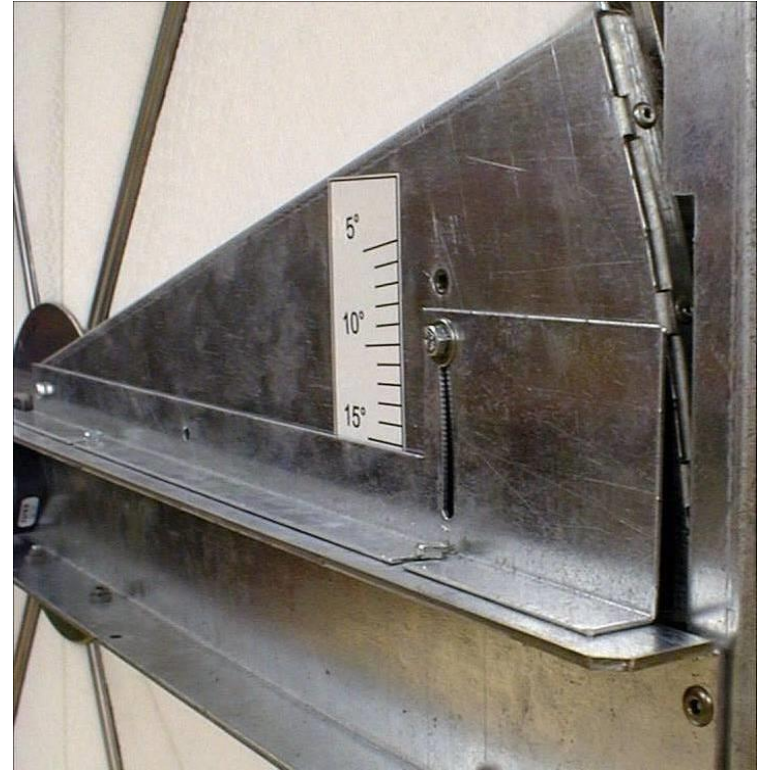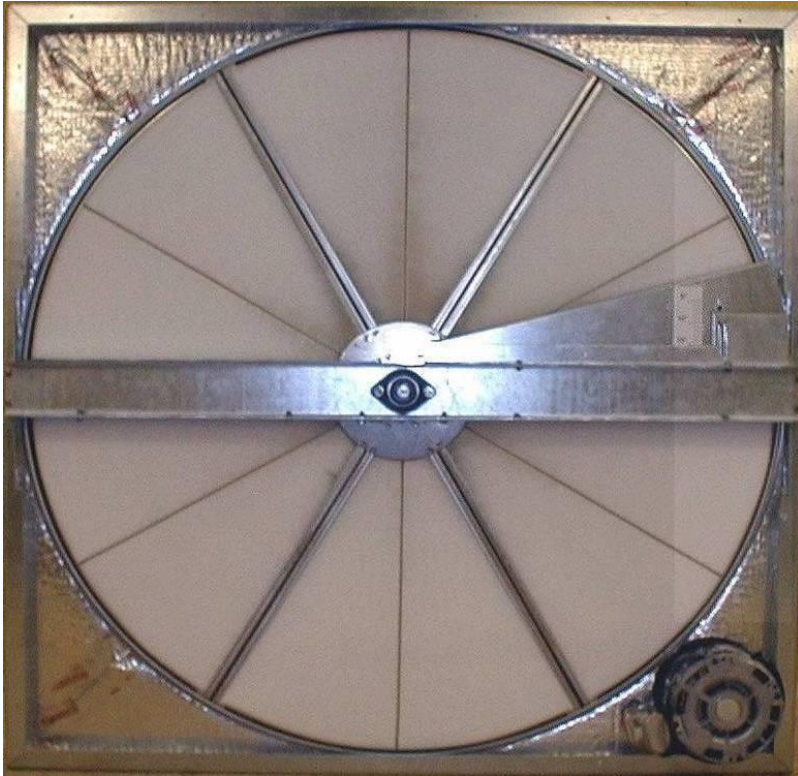

Heat Wheel Frost Control:

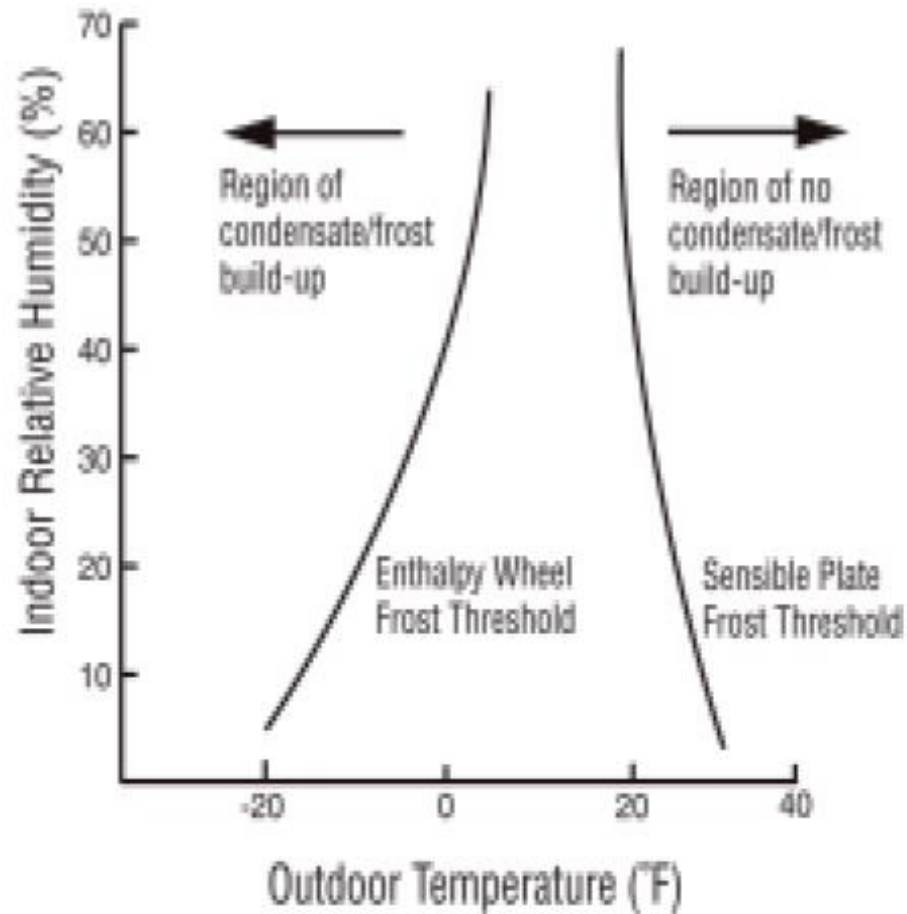

Heat Wheel Frost Control:

- Frost Threshold Temperature (FTT)
 - Temperature Below Which Frost Accumulates
 - Function of OAT and Indoor RH
- Wheel FTT: -20 to 5F
- Remove Water From EA, Lowering DP Of Exhaust, Water Then Picked Up By Entering OA

Heat Wheel Frost Control:

Frost Threshold Temperature (°F)				
Indoor Air RH (%)	Indoor Air Dry Bulb Temperature			
	70° F	72° F	75° F	80° F
20	-14	-13	-11	-8
30	-3	-2	-1	3
40	5	7	9	11
50	12	13	15	18
60	18	19	21	26

Heat Wheel Frost Control:

- VFD
 - Slow Down Wheel To Gain More Exposure To EA
 - Reduces Effectiveness
- Preheat
 - Lowers OAT RH, Lowers FTT
- Bypass Dampers
 - Bypass Supply Air
- On/Off Wheel
 - Expose Wheel To More EA

Heat Wheel Frost Control:

Outdoor Winter Design Temp.	Indoor Air (Return) Conditions					
	70°F and 20%RH (Frost Threshold -14°F)		70°F and 30%RH (Frost Threshold -3°F)		70°F and 40%RH (Frost Threshold 5°F)	
	Preheat Temperature At Design	Required Capacity ΔT	Preheat Temperature At Design	Required Capacity ΔT	Preheat Temperature At Design	Required Capacity ΔT
5	-	-	-	-	-	-
0	-	-	-	-	2.5	2.5
-5	-	-	-4.3	0.7	0.8	5.8
-10	-	-	-6.3	3.7	-0.6	9.4
-15	-14.7	0.3	-7.9	7.1	-1.7	13.3
-20	-16.7	4.3	-9.1	10.9	-2.5	17.5
-25	-18.3	6.7	-10	15	-3.1	21.9
-30	-19.4	10.6	-10.7	19.3	-3.6	26.4
-35	-20.3	14.7	-11.3	23.7	-3.9	31.1
-40	-21	19	-11.7	28.3	-4.2	35.8

Fungal Growth:


- Silica Gel Based Desiccant Wheels Transfer Water Molecules By Sorption
- Sorption – Physical & Chemical Process Where One Substance Becomes Attached To Another
- Condensation Does Not Occur
- Transfer Of Water Occurs In Vapor Or Gas Phase
- Frosting Does Not Support Fungal Growth

Odors:

- Forms From Dirt, Tar Or Grease Accumulation
- Remove With Frequent Cleaning
- Similar Issues If Don't Maintain Filters


Heat Wheel Maintenance:

- Wheels need to be 'deep' cleaned just like evap coils to maintain latent recovery performance.
- It is easier and less risky to clean a wheel outside of the HVAC unit than within.
- Follow manufacturers instructions.

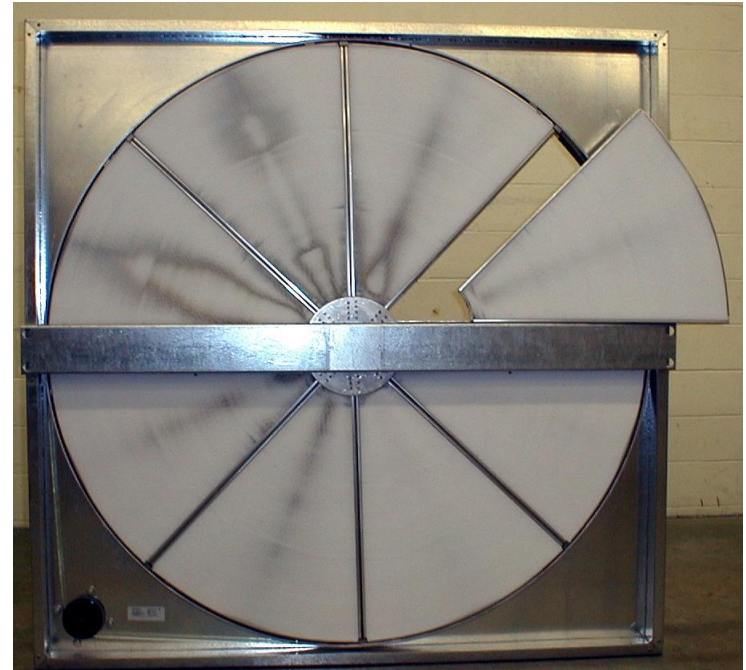


Heat Wheel Maintenance:


- Wheel is accessed and segment is removed.
- Segment is soaked in alkaline cleaner.
- Segment is rinsed and drained.
- Segment is dried and ready for use.

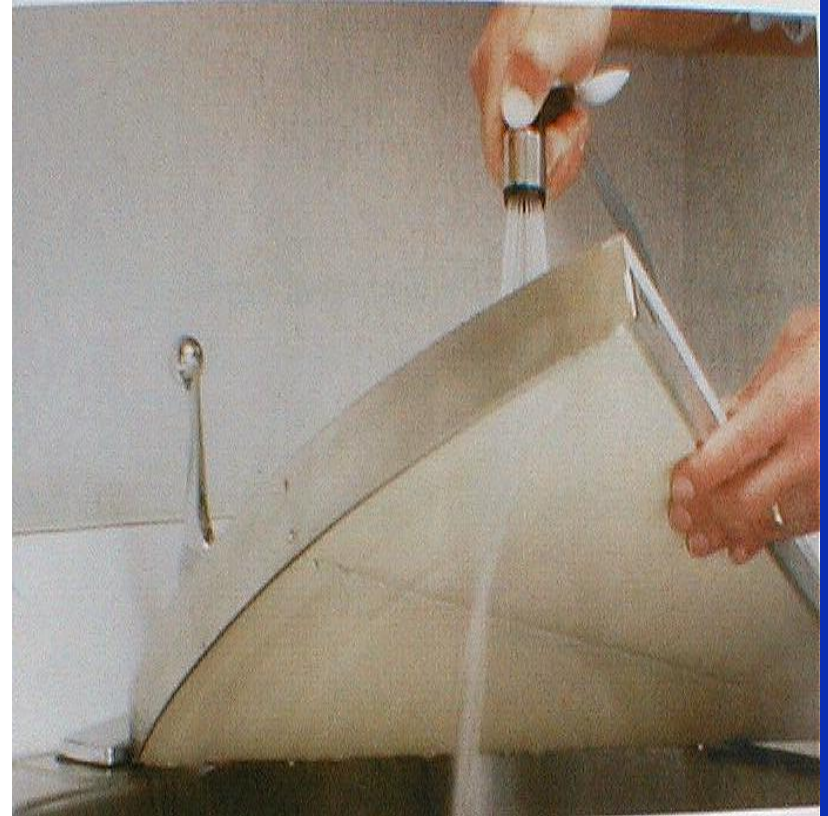


MOCP Comparison:

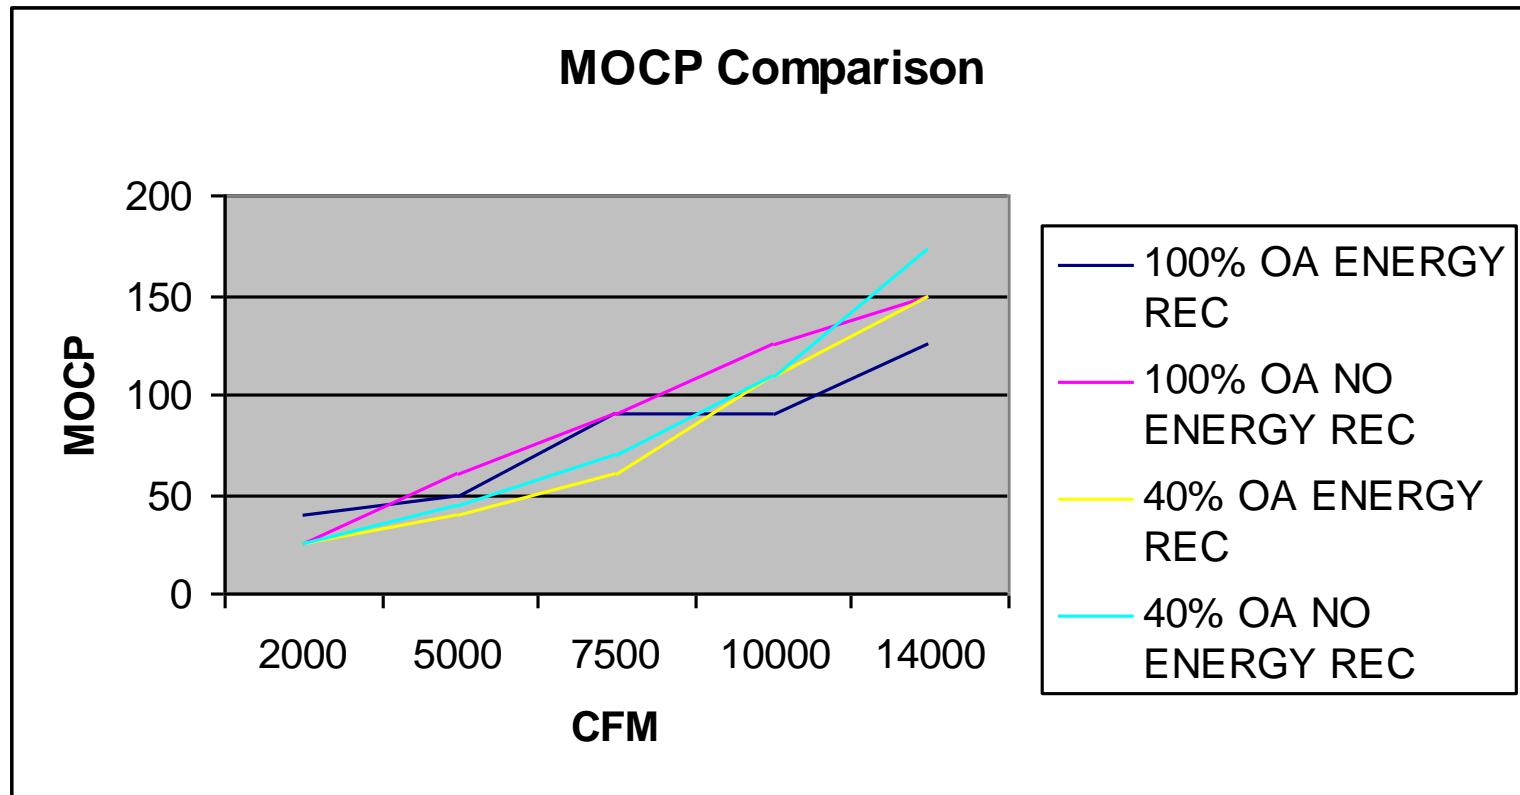

EER Comparison:

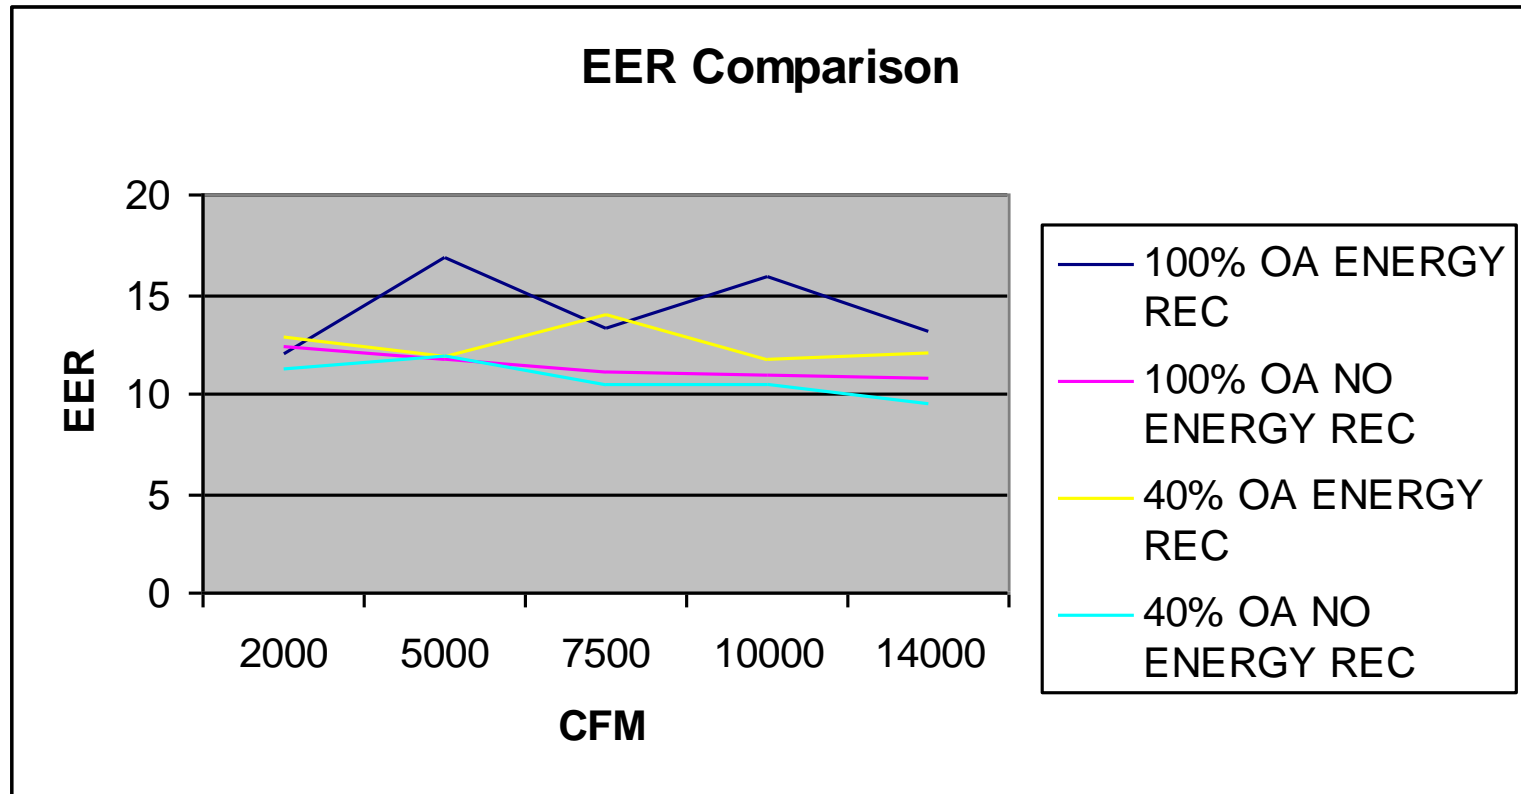

Cost Comparison:

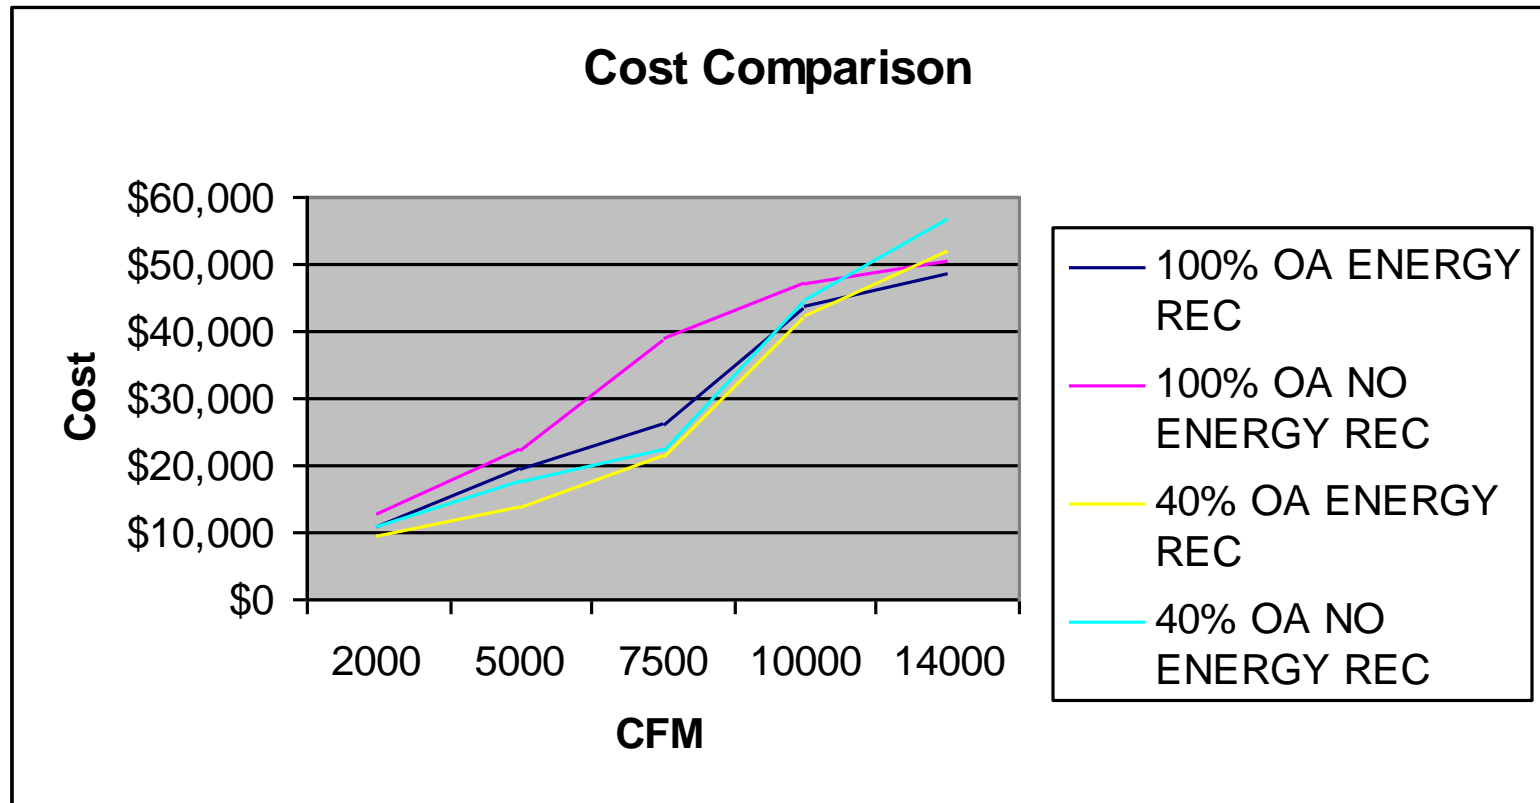


Heat Wheel Applications:

- Over 40% OA
- Schools
- Hospitals
- Churches
- Gymnasiums
- Nursing Homes
- Hotels/Motels
- Recreation Centers
- Offices
- Dedicated Outdoor Air Systems
- Dorms
- Terminal Unit Projects:
 - Heat pumps
 - Ptacs
 - Fan coils
 - Chilled Beams
 - VRF
- LEED Projects

Plate Heat Exchanger:


- Sensible energy recovery only
- Large face area design
- Higher frost threshold
- No moving parts involved
- Minimal maintenance required
- No potential cross-contamination
- 65-70% effectiveness
- 25 year + lifetime

Plate Heat Exchanger:

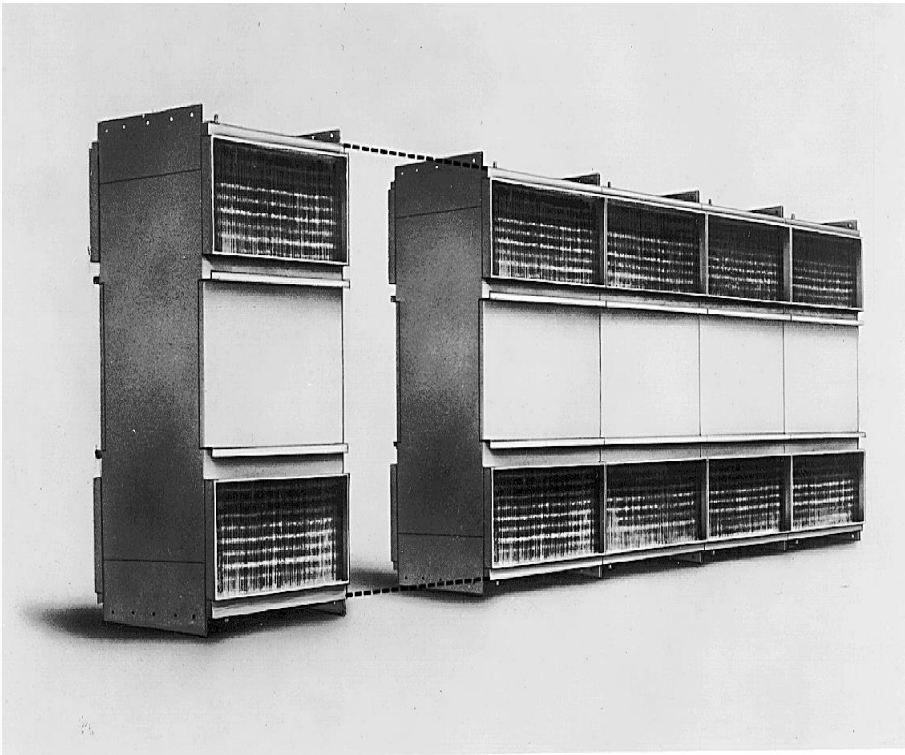


- Incorporated in Packaged Heat Recovery & Dehumidification Equipment
- Available with aluminum or stainless steel construction
- 450 Deg. Maximum operating temperature
- Nominal 68% Efficiency
- Modular Design
- Variable Plate Spacing

Counter Flow Plate Heat Exchanger:

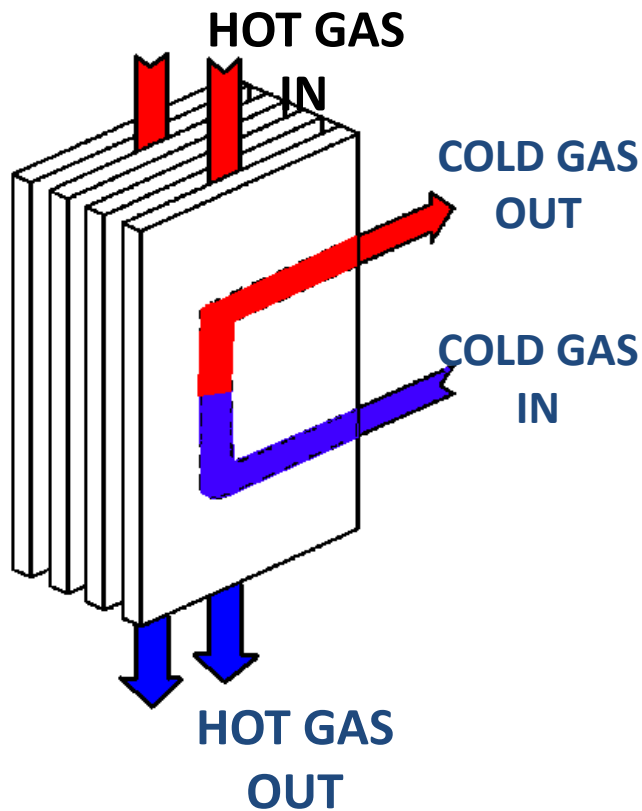

- Two streams flow counter current
- Max potential for plate HX
- Longer the flow length, the more effective the heat exchanger
- Up to 85% effectiveness

Cross Flow Plate Heat Exchanger:

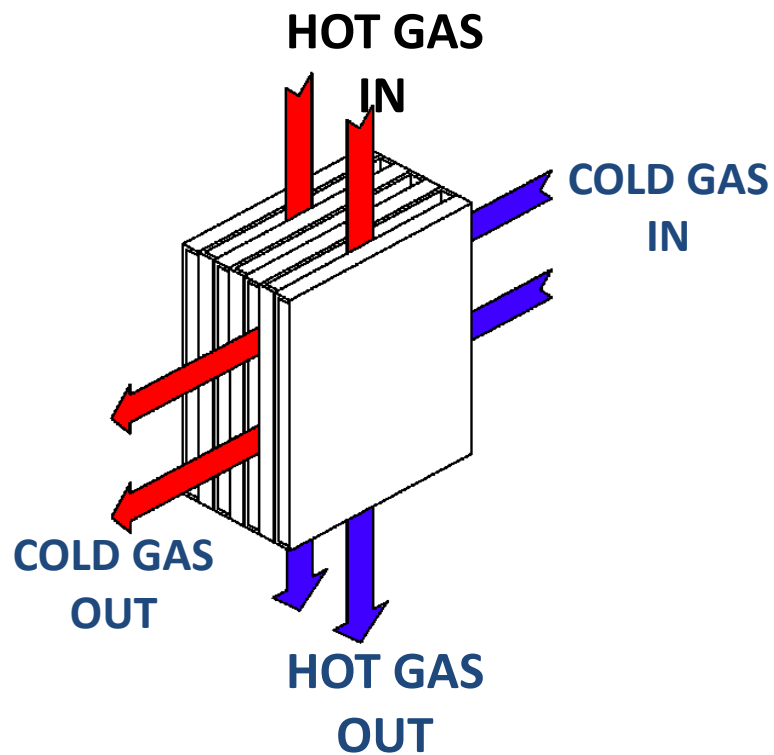

- Two air streams are 90° from each other

Plate Heat Exchanger:


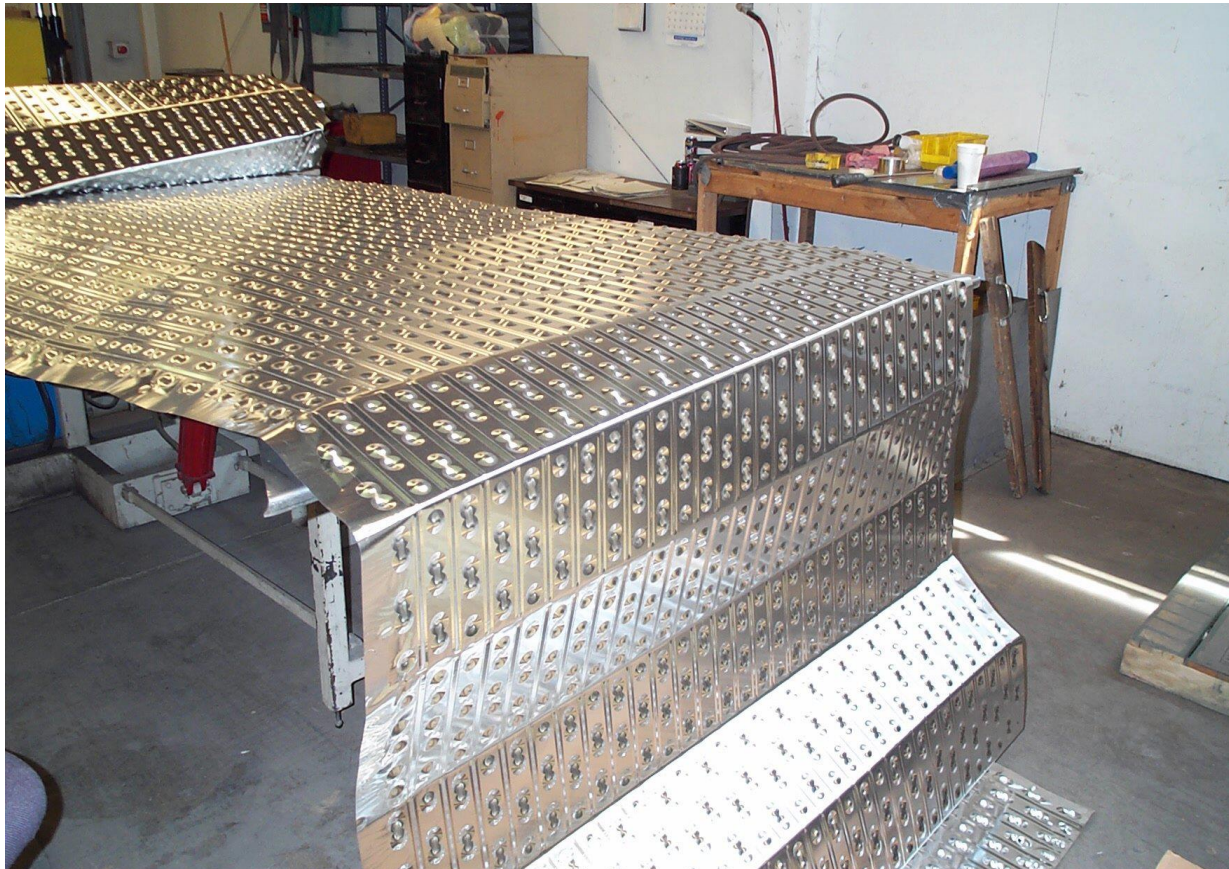


Plate Heat Exchanger:

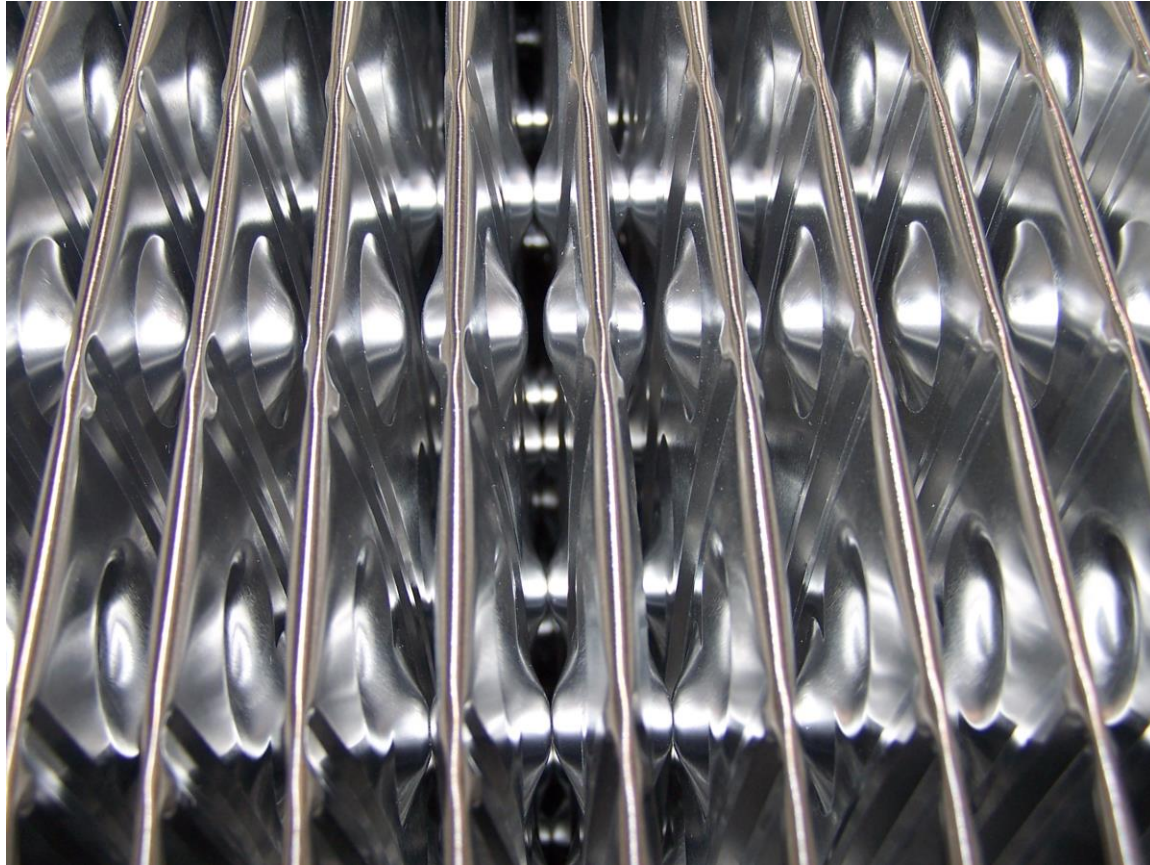

Cross Flow Plate Heat Exchanger:

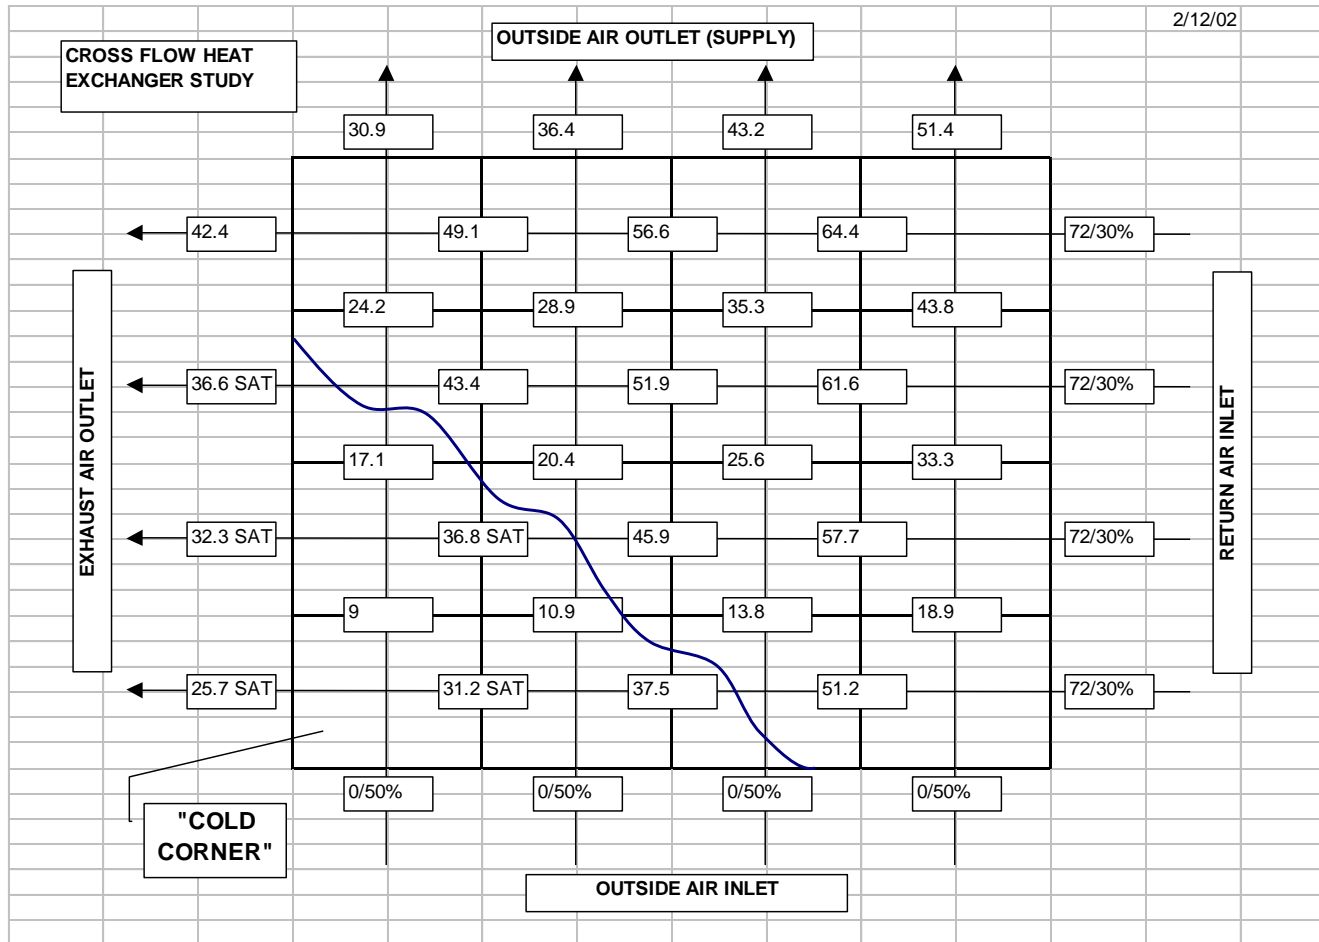


Plate Heat Exchanger Applications:


- Hospitals
- Clean rooms
- Pool units
- LEED Projects
- Projects with Class 4 air

Heat Pipe:


- Sensible energy recovery only
- Compact face area design
- No moving parts involved
- Minimal maintenance required
- No potential cross-contamination
- 55-60% effectiveness
- 25 year + lifetime
- Potential charge leak

Heat Pipe:

CUT-AWAY VIEW OF HEAT PIPE

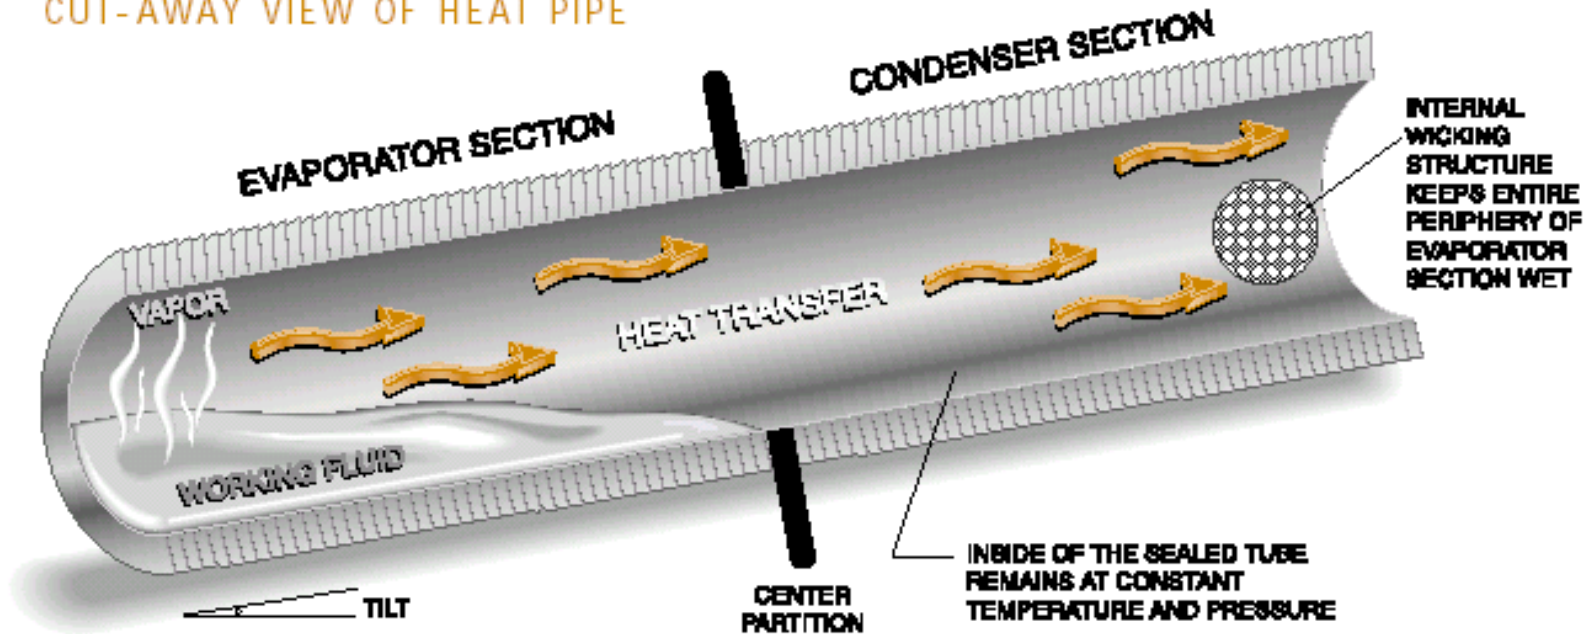


Heat Pipe:

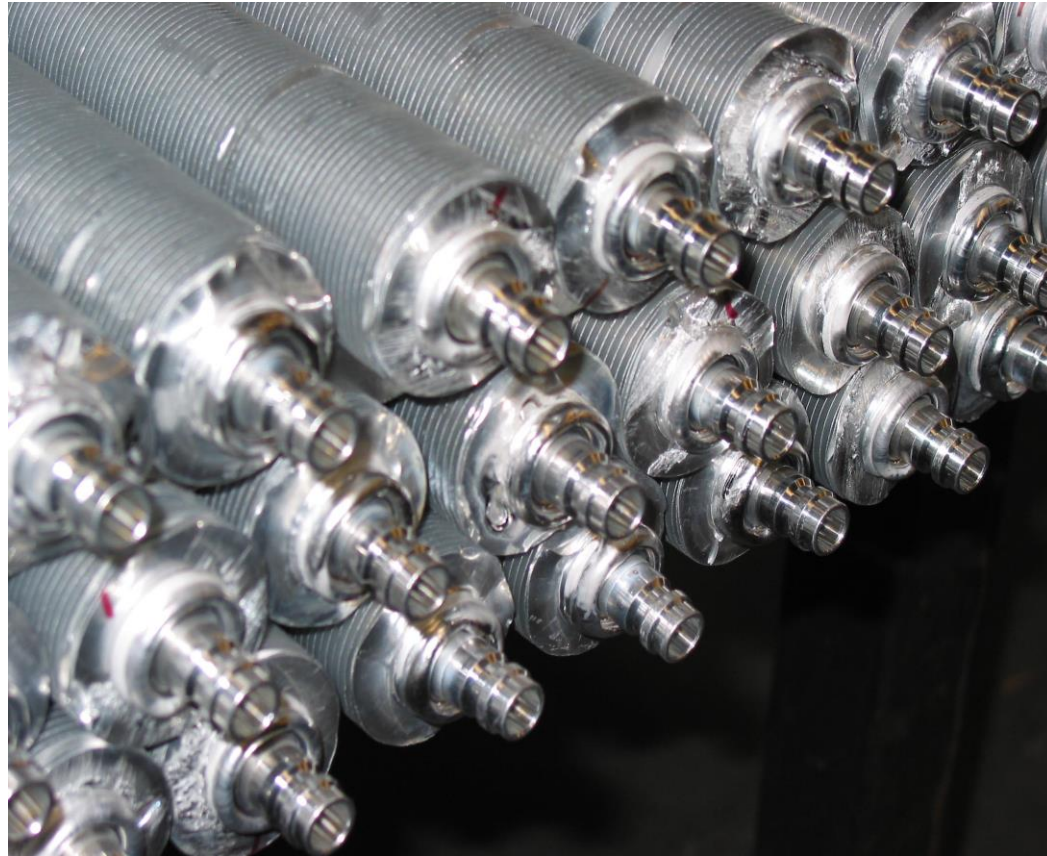

Heat Pipe:




Wrap Around Heat Pipe:

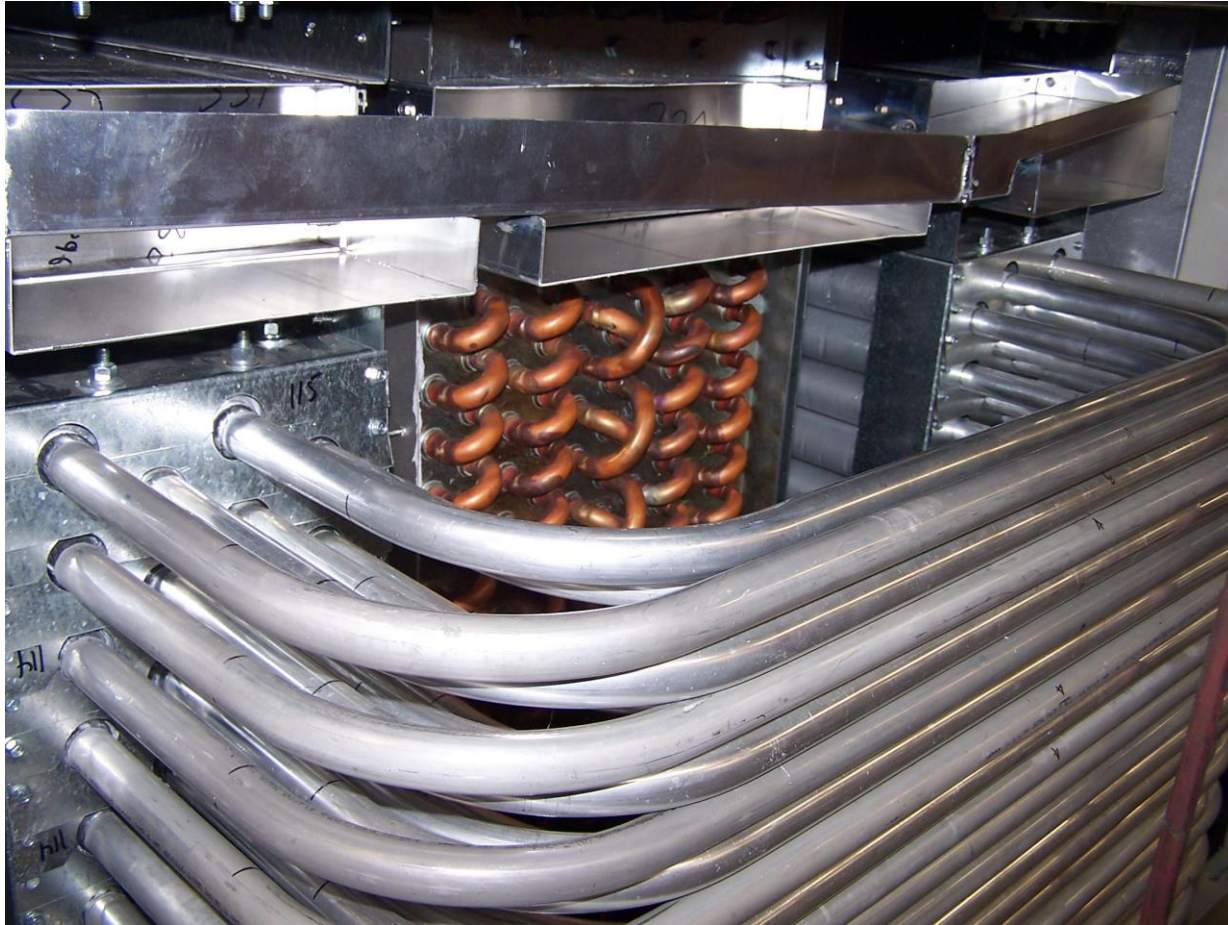


Heat Pipe Applications:

- Hospitals
- Clean rooms
- Pool units
- LEED projects
- Projects with Class 4 air

Brute Force:

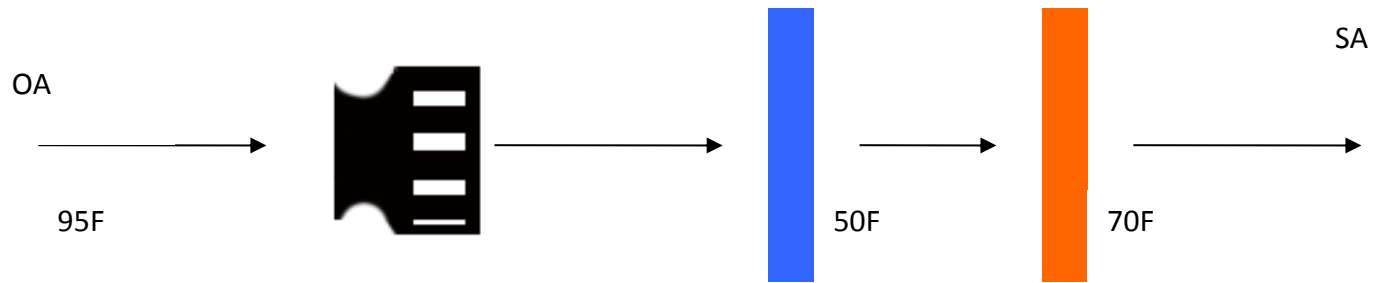


Brute Force:

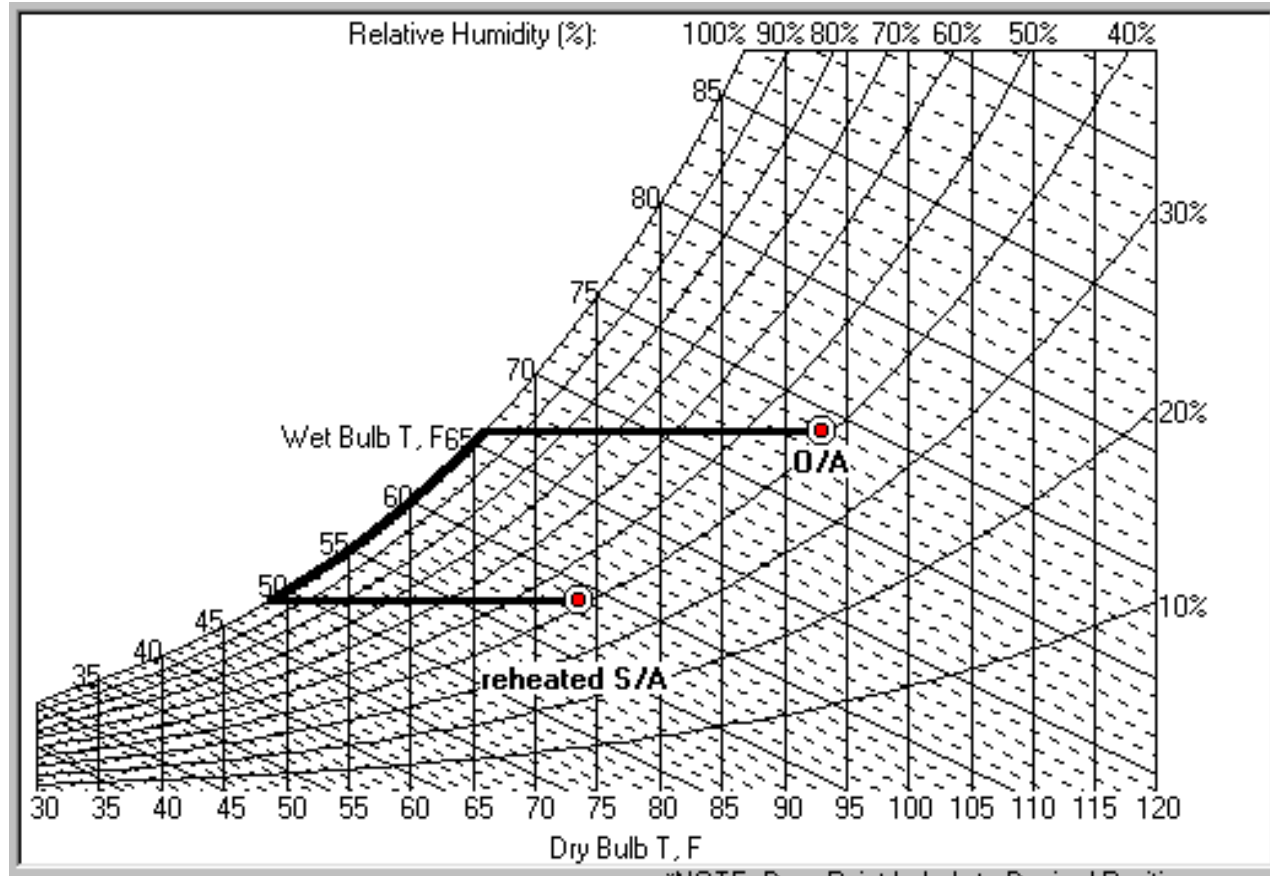


Total Energy Recovery:

Total Energy Recovery

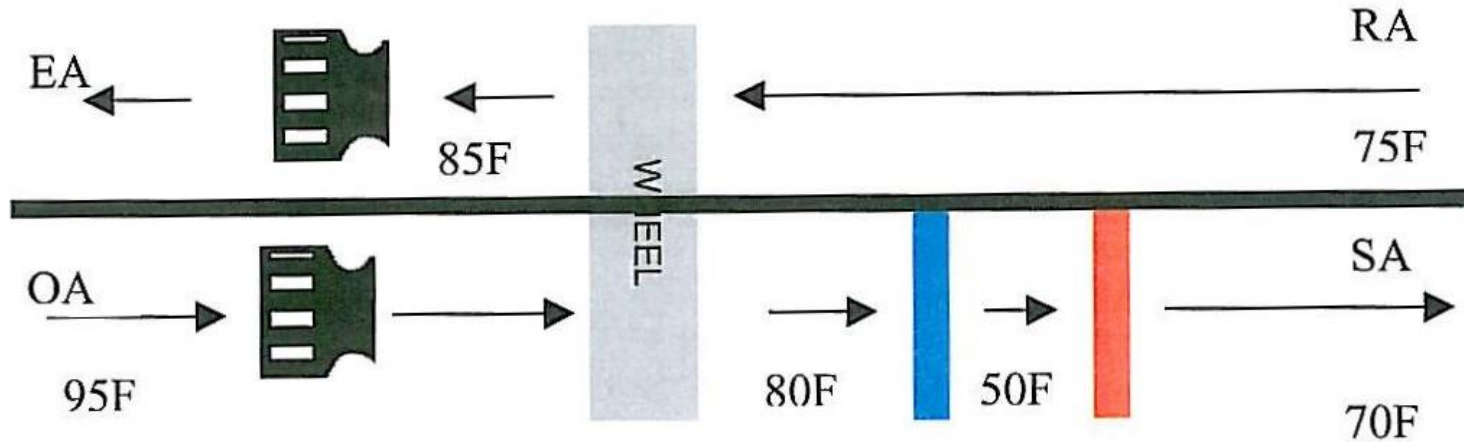


Total Energy Recovery:

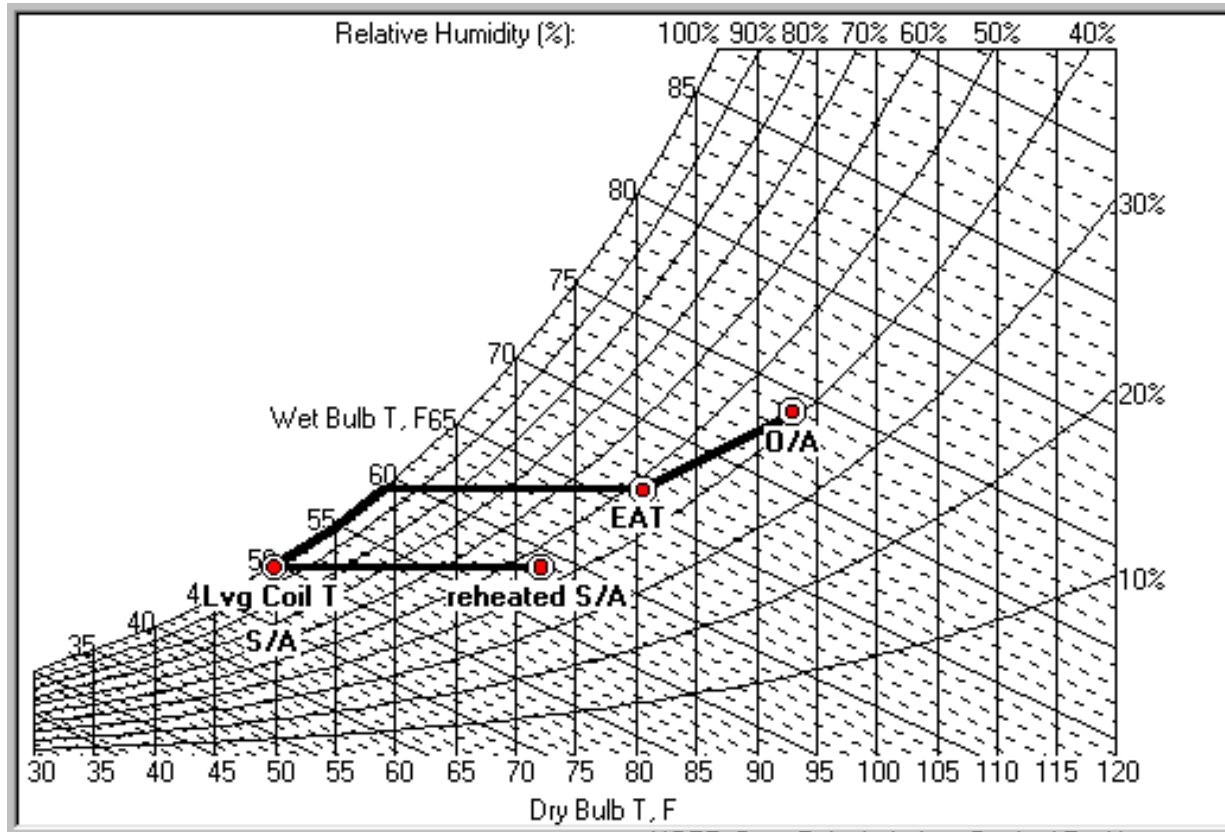


Dual Energy Recovery System:

Total Wringer Plus

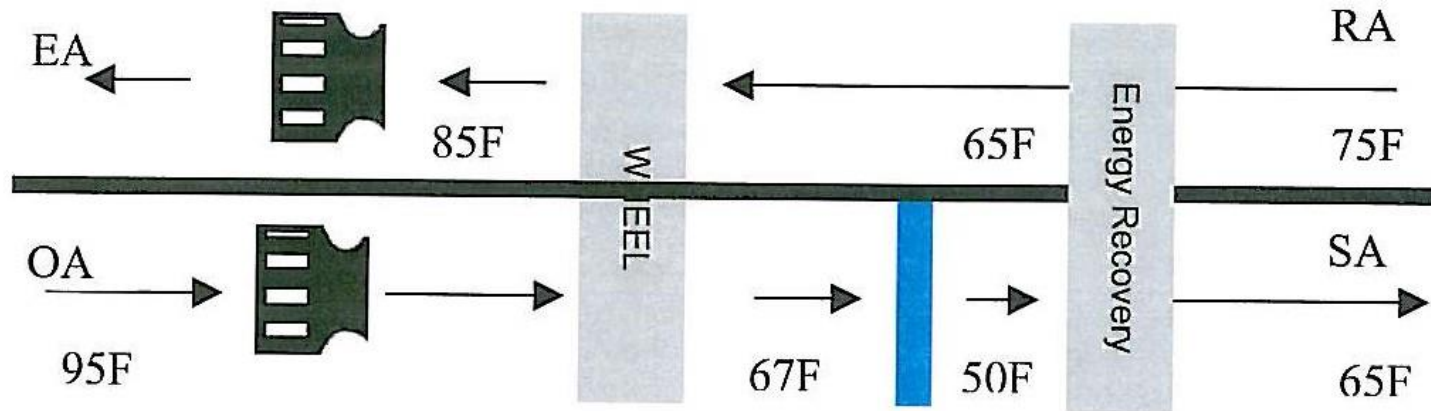

Dual Energy Recovery System:

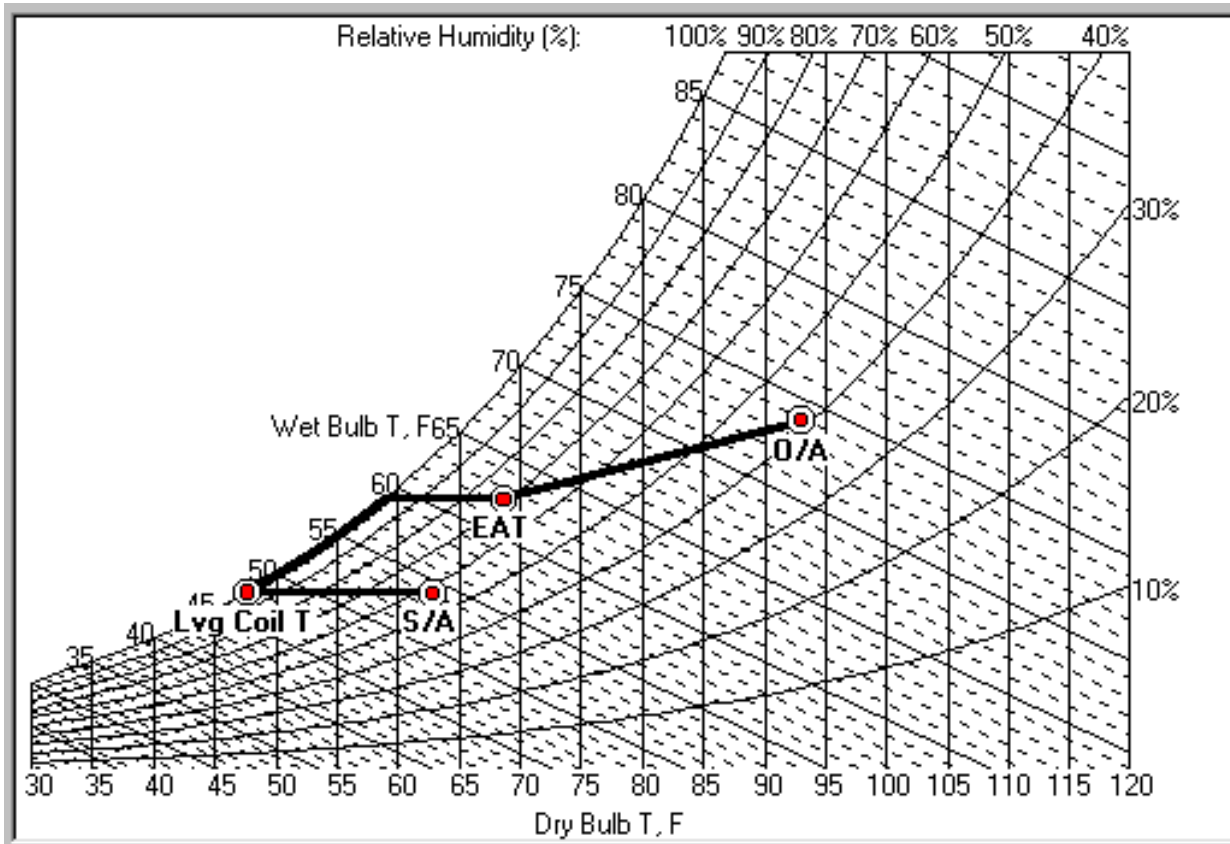

Cost Comparison:

\$0.10/Kwh, \$10/Million
BTUH, 20,000 CFM, 50%
Time Operation

Akron, OH

SUMMARY

TEMPERATURES DRY BULB	MCWB	TOTAL HOURS AT CONDITION	TOTAL HOURS OF OPERATION	BRUTE FORCE (MBB)	MZP (MBS)	PVR (MBT)	WRINGER (MWB)	SWP (MWS)	TWP (MWT)
102	74	0	0.00	\$0.00	\$0.0	\$0.0	\$0.0	\$0.00	\$0.00
97	72	2	1.00	\$16.81	\$13.8	\$11.9	\$8.1	\$8.26	\$5.87
92	72	22	11.00	\$185.31	\$159.9	\$131.5	\$89.7	\$98.78	\$64.70
87	71	106	53.00	\$853.82	\$767.5	\$624.9	\$427.1	\$472.82	\$303.12
82	69	270	135.00	\$1,977.13	\$1,848.9	\$1,548.1	\$1,098.9	\$1,098.23	\$728.61
77	66	439	219.50	\$2,754.82	\$2,695.3	\$2,416.0	\$1,666.4	\$1,474.67	\$1,083.50
72	64	669	334.50	\$4,894.07	\$4,894.1	\$3,585.3	\$2,618.4	\$2,035.92	\$1,554.76
67	61	832	416.00	\$5,305.34	\$5,305.3	\$5,305.3	\$3,118.4	\$3,048.49	\$2,777.28
62	57	773	386.50	\$4,027.19	\$4,027.2	\$4,027.2	\$2,592.9	\$2,192.51	\$2,381.91
57	52	697	348.50	\$1,701.55	\$794.1	\$595.5	\$1,701.6	\$581.36	\$522.94
52	48	643	321.50	\$2,005.76	\$889.5	\$645.3	\$2,005.8	\$627.89	\$567.19
47	43	617	308.50	\$2,343.06	\$1,004.2	\$711.3	\$2,343.1	\$690.37	\$617.56
42	39	625	312.50	\$2,797.27	\$1,169.8	\$813.7	\$2,797.3	\$788.32	\$699.83
37	35	665	332.50	\$3,427.24	\$1,407.0	\$965.0	\$3,427.2	\$933.47	\$823.62
32	30	825	412.50	\$4,811.30	\$1,946.9	\$1,320.3	\$4,811.3	\$1,275.55	\$1,119.80
27	26	641	320.50	\$4,172.91	\$1,669.2	\$1,121.5	\$4,172.9	\$1,082.35	\$946.21
22	21	431	215.50	\$3,098.08	\$1,227.5	\$818.4	\$3,098.1	\$789.13	\$687.42
17	16	236	118.00	\$1,856.44	\$729.8	\$483.3	\$1,856.4	\$465.71	\$404.45
12	11	160	80.00	\$1,367.10	\$533.8	\$351.5	\$1,367.1	\$338.52	\$293.21
7	7	67	33.50	\$617.91	\$239.9	\$157.2	\$617.9	\$151.30	\$130.74
2	1	29	14.50	\$287.12	\$110.9	\$72.4	\$287.1	\$69.62	\$60.04
-3	-3	12	6.00	\$126.95	\$48.8	\$31.7	\$126.9	\$30.52	\$26.27
TOTAL				\$48,627.16	\$31,483.45	\$25,737.48	\$40,232.64	\$18,253.79	\$15,799.05
FAN HP COSTS				\$0.00	\$3,420.05	\$3,420.05	\$2,470.03	\$5,320.07	\$6,080.08
ANNUAL TOTAL				\$48,627.2	\$34,903.5	\$29,157.5	\$42,702.7	\$23,573.9	\$21,879.1



Heat Exchanger Comparison:

	PLATE	HEAT PIPE	WHEEL
NOMINAL SENSIBLE EFFECTIVENESS	68%	58%	75%
NOMINAL LATENT EFFECTIVENESS	0%	0%	75%
MOVING PARTS	NO	NO	YES
MAINTENANCE REQUIREMENTS	MINIMAL	MINIMAL	HIGH
PARTICULATE PASSAGE	EXCELLENT	GOOD	NOT GOOD
LEAKAGE	NONE	NONE	5% - 20%
CLEANABILITY	EXCELLENT	GOOD	NOT GOOD
SIZE	LARGE	COMPACT	VERY COMPACT
LIFE EXPECTANCY	25 YRS +	25 YRS +	10 YRS +
COST	\$1/CFM	\$1/CFM	\$1/CFM
MARKET VARIANCE	COUNTER-FLOW VS. CROSS FLOW	ONE-PIECE INDIVIDUALLY CHARGED VS. TWO PIECE MULTIPLE TUBE CHARGE	VOLLUTED VS. RIBBON. SYNTHETIC VS. ALUMINUM. 4A VS. 3A

Manufacturers:



Engineering and Manufacturing
Specialty HVAC Equipment Since 1971

Thank You!

